

The reduction of gas concentrations in broiler houses through ventilation: Assessment of the thermal and electrical energy consumption

Original

The reduction of gas concentrations in broiler houses through ventilation: Assessment of the thermal and electrical energy consumption / Costantino, Andrea; Fabrizio, Enrico; Villagr , Arantxa; Estell s, Fernando; Calvet, Salvador. - In: BIOSYSTEMS ENGINEERING. - ISSN 1537-5110. - STAMPA. - 199:(2020), pp. 135-148.
[10.1016/j.biosystemseng.2020.01.002]

Availability:

This version is available at: 11583/2920332 since: 2021-10-08T22:49:40Z

Publisher:

Elsevier

Published

DOI:10.1016/j.biosystemseng.2020.01.002

Terms of use:

This article is made available under terms and conditions as specified in the corresponding bibliographic description in the repository

Publisher copyright

(Article begins on next page)

The reduction of gas concentrations in broiler houses through ventilation: assessment of the thermal and electrical energy consumption

Andrea Costantino^{1,2*}, Enrico Fabrizio², Arantxa Villagrà³, Fernando Estellés¹, Salvador Calvet¹

¹*Institute of Animal Science and Technology, Universitat Politècnica de València, Camino de Vera s/n, 46022, València, Spain*

²*DENERG, Politecnico di Torino, TEBE Research Group, Corso Duca degli Abruzzi 24, 10129 Torino, Italy*

³*Centro de Tecnología Animal, Instituto Valenciano de Investigaciones Agrarias, Polígono de la Esperanza 100, 12400, Segorbe, Castellón, Spain*

*Corresponding author. Tel: +39 0110904552

E-mail address: andrea.costantino@polito.it

Abstract

Ammonia and carbon dioxide are the most relevant among the harmful gases present in broiler houses and their effects on animal health depend on concentration and exposure time. Inside these houses, increasing ventilation is the most common strategy adopted to control the concentration of these gases. This strategy is effective but increases the electrical energy consumption (for fan operation) and the thermal energy consumption (for inlet air heating). In this work, the variations of the energy consumptions due to the increase of ventilation for maintaining ammonia and carbon dioxide concentrations below established thresholds were evaluated. To carry out this analysis, various parameters (e.g. indoor air temperature and gas concentrations) of a broiler house located in the Mediterranean area were monitored during a production cycle in the cool (winter) season in which outdoor air temperature varied between 2 and 25 °C. The assessment of the increase of the energy consumption for climate control was carried out using the Specific Fan Performance and a customized building energy simulation model.

The analysis showed that during the monitored period, the established thresholds of gas concentrations were exceeded approximately 60% of time. To maintain the desired gas concentration, the ventilation flow rate should be increased by 9%. This variation in the ventilation flow rate entailed a rise in the energy consumption by about 10% for electrical energy and by about 14% for thermal energy. Maintaining the gas concentration below the established thresholds entails an extra cost of around 0.02 € per harvested broiler.

Keywords: broiler production; climate control; animal breeding; energy assessment; ammonia emission; animal welfare

Nomenclature

| | | |
|-----------|---|---|
| Air | air (subscript) | |
| b | broiler (subscript) | |
| b_0 | coefficient for <i>SFP</i> calculation | [m ³ Wh ⁻¹] |
| b_1 | coefficient for <i>SFP</i> calculation | [m ³ Wh ⁻¹ Pa ⁻¹] |
| b_2 | coefficient for <i>SFP</i> calculation | [m ³ Wh ⁻¹ Pa ⁻²] |
| C | cooling (subscript) | |
| c | central (subscript) | |
| C | gas mass concentration | [ppm] |
| \bar{C} | gas mass concentration (mean value) | [ppm] |
| E | energy consumption with actual ventilation | [kWh] |
| E' | energy consumption with increased ventilation | [kWh] |
| e | exhaust (subscript) | |
| el | electrical energy (subscript) | |
| f | primary energy conversion factor | [kWh _p kWh ⁻¹] |
| fan | fan (subscript) | |
| H | heating (subscript) | |
| hor | horizontal (subscript) | |
| I | solar irradiance | [W m ⁻²] |
| i | indoor (subscript) | |
| IAQ | Indoor Air Quality | |
| j | generic hourly time step (subscript) | |
| l | large fans (subscript) | |
| lim | gas concentration limit (subscript) | |
| m | molecular mass | [kg mol ⁻¹] |
| o | outdoor (subscript) | |
| p | primary energy (subscript) | |
| \dot{q} | gas emission | [mg h ⁻¹] |
| RH | air relative humidity | [%] |

| | | | |
|----|-------------------|---|------------------------------------|
| 65 | s | small fans (subscript) | |
| 66 | set | set point (subscript) | |
| 67 | SFP | specific fan performance | $[\text{m}^3 \text{Wh}^{-1}]$ |
| 68 | th | thermal energy (subscript) | |
| 69 | tot | total (subscript) | |
| 70 | U -value | steady-state thermal transmittance | $[\text{W m}^{-2} \text{K}]$ |
| 71 | V_{mol} | molar volume | $[\text{m}^3 \text{mol}^{-1}]$ |
| 72 | \dot{V} | actual ventilation air flow rate | $[\text{m}^3 \text{h}^{-1}]$ |
| 73 | \dot{V}' | increased ventilation air flow rate | $[\text{m}^3 \text{h}^{-1}]$ |
| 74 | w | live weight | $[\text{kg}]$ |
| 75 | x | generic gas (subscript) | |
| 76 | Δp | static pressure difference | $[\text{Pa}]$ |
| 77 | $\Delta \dot{V}'$ | difference between actual and increase ventilation | $[\text{m}^3 \text{h}^{-1}]$ |
| 78 | η | conversion efficiency | $[-]$ |
| 79 | θ | temperature | $[\text{°C}]$ |
| 80 | θ' | temperature (considering the increased ventilation) | $[\text{°C}]$ |
| 81 | κ | areal heat capacity | $[\text{kJ m}^{-2} \text{K}^{-1}]$ |
| 82 | Φ | heat load | $[\text{kW}]$ |
| 83 | Φ' | heat load considering the increased ventilation | $[\text{kW}]$ |
| 84 | ω | percentage of activation time of the fans | $[\%]$ |

85

86 1 Introduction

87 The accumulation of aerial pollutants inside animal farms impairs animal health and welfare
88 and reduces farm efficiency and productivity. The most relevant among the harmful gases in
89 broiler houses are ammonia (NH_3) and carbon dioxide (CO_2). Their effects on broilers depend
90 on their concentration as well as on the exposure duration.

91 Atmospheric NH_3 in poultry facilities has been recognized as a significant environmental
92 problem, as well as a detriment to poultry health, performance and welfare (Kristensen,
93 Burgess, Demmers, Wathes, 2000). It causes ocular damages when broilers are exposed to 25
94 and 50 ppm (1 ppm of NH_3 is 0.7 mg m^{-3} at atmospheric pressure and 25 °C of gas
95 temperature) for 14 days (Olanrewaju et al., 2007), and keratoconjunctivitis and other eye
96 disorders when exposed to 60 ppm (Valentine, 1964; Beker, Vanhooser, Swartzlander, Teeter,

2004). Ammonia is also absorbed by the distal airway mucus, which enhances mucosal inflammation and bacterial contamination of the lungs (Gustin, Urbain, Prouvost, Ansay, 1994). Moreover, exposure to NH_3 also promotes the development of infections (Kristensen and Wathes, 2000) and enhances susceptibility to respiratory diseases (Beker et al., 2004). Breast blisters have also been found in environments of 25 and 50 ppm of NH_3 (Quarles and Kling, 1974). More recently, it was found that broilers exposed to 25 ppm of NH_3 had a higher expression of genes potentially inhibiting growth and development of breast muscle, compared to broilers exposed to 3 ppm (Yi et al., 2016).

High CO_2 concentrations have negative consequences on broilers due to both the direct effect of this gas and the decrease in the oxygen concentration (McGovern, Feddes, Zuidhof, Hanson, Robinson, 2001). According to Gerritzen, Lambooij, Reimert, Stegeman, and Spruijt, (2007), broilers start to notice instantaneously the presence of CO_2 at 24,000 ppm (1 ppm of CO_2 is 1.8 mg m^{-3} at atmospheric pressure and 25°C of gas temperature). Higher concentration values in the breathing air may cause gasp (92,000 ppm) and convulsions (300,000 ppm). Lower concentrations of CO_2 could affect broiler health when they are in contemporaneity with high exposure times. For example, when broilers are exposed to CO_2 concentrations between 3,000 and 6,000 ppm for 14 days, body weight is depressed and late mortality increases (Olanrewaju et al., 2008).

According to these findings, it is recommended to maintain NH_3 and CO_2 concentrations below certain limits. In some regions, welfare regulations have also established concentration limits. European Council Directive 2007/43/EC (European Council, 2007) sets the minimum requirements for the protection of broilers kept for meat production and, among these rules, it establishes the maximum density for reared broilers at 33 kg m^{-2} . However, the maximum rearing density can be increased up to 42 kg m^{-2} when specific environmental control requirements are accomplished. Among these requirements, NH_3 concentration must be kept below 20 ppm and CO_2 concentration below 3,000 ppm at the level of the broilers' heads. It has been reported that most commercial farms across Europe rear broilers at densities higher than 33 kg m^{-2} (Verspecht, Vanhonacker, Verbeke, Zoons, Van Huylenbroeck, 2011). However, gas concentrations exceeding the limits established by the 2007/43/EC Directive have also been reported in commercial poultry houses for both NH_3 (Groot Koerkamp et al., 1998) and CO_2 (Knížatová et al., 2010).

Ventilation design and operation is critical to maintain gas concentrations below harmful levels. Increasing the ventilation rate reduces gas concentration by dilution, which is simple in terms of management and could be easily carried out by the automatic climate control systems installed in farms. However, increasing the ventilation rates increases energy consumption and, consequently, may entail an extra cost for the farmer. This is due to the extra electrical energy needed for operating the fans and to the extra supplemental heating load needed to maintain the indoor air set point temperature, particularly in cold conditions (Costantino & Fabrizio, 2020). Furthermore, climate control systems are mostly programmed to control only air temperature and relative humidity inside livestock houses (Zhang and Barber, 1995) and therefore installation of specific sensors is required.

Rearing broilers involves a high energy consumption compared with other livestock farms. According to Costantino, Fabrizio, Biglia, Cornale and Battaglini (2016), climate control in broiler farms uses between 85 and 135 kWh_{th} m⁻² a⁻¹ (1 kWh = 3.6 MJ) of thermal energy and between 4 and 11 kWh_{el} m⁻² a⁻¹ of electrical energy. These values represent 96% of the total thermal energy and 75% of the total electrical energy consumptions of the house. These high energy consumptions reflect also in the running costs of the farm: in the European context, the energy share represents 20% of the total production cost of a broiler (excluding feedstuff) and can be estimated between 0.04 and 0.09 € broiler⁻¹ (Oviedo-Rondón, 2010). Finally, considering that the meat production is estimated to increase by 70% in 2050 (FAO, 2011), the use of energy is also expected to increase in the primary sector (Thornton, 2010). For these reasons, quantifying potential impacts of increasing ventilation on energy consumption is of a foremost importance.

The objective of this work is to explore how energy consumption is affected by the increase of the ventilation rates in a commercial broiler house to fulfil the recommended thresholds of gas concentrations. This kind of analysis is not present in literature and may be useful for both engineers and farmers.

To carry out this work, NH₃ and CO₂ concentrations and their thresholds established by the European regulation (20 and 3,000 ppm in mass, respectively) are considered. For the analysis, a mechanically ventilated broiler house located in a Mediterranean area was selected as a case study and it was monitored during a production cycle carried out in cool (winter) season. The monitoring campaign provided the gas concentrations and the needed inputs for estimating the thermal and electrical energy consumption.

2 Materials and methods

2.1 Overview on the experimental and simulation activity

The experimental activity concerned the monitoring of indoor and outdoor gas concentrations (CO_2 and NH_3), indoor and outdoor environmental conditions, static pressure difference between inside and outside the broiler house and the working time of the fans. The monitoring campaign concerned 40 days out of 47 of a production cycle carried out during the cool season (December and January). The first week of the production cycle was not monitored. When NH_3 and CO_2 concentrations exceeded 20 and 3,000 ppm (respectively), the theoretical extra ventilation flow rate needed to maintain the NH_3 and CO_2 concentrations below the established limits was estimated through a gas mass balance.

The variation of the energy consumption was assessed considering the electrical energy consumption for the operation of the fans and the thermal energy consumption for heating the enclosure. The electrical energy consumption was calculated through the Specific Fan Performance (*SFP*) obtained through regressions on the technical datasheets of the fans. The thermal energy consumption was estimated using the dynamic energy simulation model for broiler houses developed by Costantino, Fabrizio, Ghiggini, and Bariani (2018).

2.2 Case study description

2.2.1 Housing and reared broilers

The experiment was carried out in a commercial mechanically ventilated broiler house located in Vila-real (Castellón province, eastern Spain), a geographical location in a Mediterranean climate. The province of Castellón is classified as an hot-humid climate zone (ASHRAE, 2016) characterized by a mild climate with no dry season and hot summer. The heating degree days are 1579 °C d calculated considering 20 °C as base temperature and the entire year as calculation period, in compliance with EN ISO 15927-6 (European Committee for Standardisation, 2007).

The selected case study can be considered representative of the commercial broiler farms of that region. The building floor area is 1,430 m² (110 m length and 13 m width). The building has a gable roof and its height is 2.5 m at the eave level, and 4.5 m at the ridge level. The building net volume is approximately 5,000 m³.

The perimetral walls are made of concrete hollow blocks (150 mm of thickness) and cement plaster (20 mm of thickness). Part of these walls is insulated through polyurethane sandwich panels (30 mm of thickness). The roof is made of corrugated fibre-cement sheets with

fiberglass insulation panels (30 mm of thickness) and polyurethane foam (20 mm of thickness) that was applied on the inner face. The floor is a lightweight reinforced concrete screed (100 mm of thickness) in direct contact with the ground. A layer of rice hulls of about 100 mm is used as bedding material and the litter is removed at the end of each production cycle. To perform the energy simulations, an additional 1.5 m of soil layer is added to the previously described floor layers with the aim of considering the effect of the ground on the building thermal behaviour. The heat flow via the ground was calculated using as thermodynamic driving force the difference between the indoor air temperature ($\theta_{\text{air,i}}$) and the outdoor air temperature ($\theta_{\text{air,o}}$).

The thermal transmittance (U -value) and the internal areal heat capacity (κ_i) of the broiler house envelope were calculated in compliance with ISO 6946 (2017a) and ISO 13786 (2017b) standards. The calculated values (reported in Table 1) are the inputs for the energy simulation model that was used to estimate the thermal energy consumption of the analysed broiler house.

Table 1 – Thermal transmittance (U -value) and internal areal heat capacity (κ_i) of the considered building elements.

| Building element | U -value [W m ⁻² K ⁻¹] | κ_i [kJ m ⁻² K ⁻¹] |
|---------------------|--|---|
| Not insulated walls | 2.40 | 56.3 |
| Insulated walls | 0.67 | 13.3 |
| Roof | 0.42 | 3.4 |
| Floor | 0.44 | 16.3 |

The production cycle started on December 15th with 12,000 male and 12,000 female broiler chicks and ended on January 31st (7 weeks cycle). The monitoring campaign started on the 7th day of the production cycle (December 22nd) and lasted 967 hours (around 40 days) until the end of the production cycle. On January 24th, 15% of the 42-day-old broilers were harvested from the building with an average weight of 2.33 kg broiler⁻¹. Total mortality during the growing period was 3.28%. The final production was 23,212 broilers with a total final live weight of 62,534 kg (2.69 kg broiler⁻¹ for 48-day-old broilers), with a feedstuff consumption of 114,000 kg and a feed conversion rate of 1.82. Rearing density at the end of the cycle was 37.05 kg m⁻², a value higher than the threshold of 33 kg m⁻² established by the European Council Directive 2007/43/EC (European Council, 2007), therefore specific environmental control requirements should be accomplished.

2.2.2 Climate control system

The broiler house is mechanically ventilated using a cross ventilation configuration. Air inlets are placed on one of the larger walls and they are automatically controlled for maintaining a constant pressure difference between inside and outside the building (Δp) during the same day. On the opposite wall there are 16 lateral exhaust fans that deal with both Indoor Air Quality (IAQ) control and cooling ventilation. The 16 fans are of two different models: nine of them are larger than the other ones. The larger fans have a maximum electrical power of 0.75 kW and in free air delivery conditions ($\Delta p = 0$ Pa) the maximum declared airflow is around 35,000 m³ h⁻¹. The remaining seven fans are smaller, have a maximum electrical power of 0.59 kW and the maximum declared airflow in free air delivery conditions is roughly 12,750 m³ h⁻¹. Both fan models are three-phase and fixed propeller speed fans, therefore the air flow and the *SFP* vary according to Δp only on a single curve.

In the broiler house, a commercial automatic control system measures the value of $\theta_{air,i}$ (through a probe inside the house) and maintains it within the deadband (2 °C of range) between the heating set point temperature ($\theta_{set,H}$) and the cooling set point temperature ($\theta_{set,C}$). When a supplemental heating load is needed to maintain $\theta_{air,i}$ above $\theta_{set,H}$, the farm automatic control system activates two propane air heaters of 85 kW. Both the air heaters are placed inside the building, therefore a conversion efficiency (η_H) of 100% is considered. Since the air heaters emit the exhaust fumes directly inside the enclosure, they contribute to the increase the CO₂ concentration.

When cooling is needed to maintain $\theta_{air,i}$ below $\theta_{set,C}$, cooling ventilation and evaporative pads are activated. Climate control system provides also a minimum ventilation flow rate (based only on the animal density) to control the IAQ.

The ventilation is managed through the activation of the 16 fans according to two different activation cycles. When low ventilation flow rates are needed (usually for IAQ control), the activation cycle lasts 15 s. When higher ventilation flow rates are needed (usually for cooling ventilation), the control system manages the fans with activation cycles of 100 s. For ventilation flow rates below 75,000 m³ h⁻¹, only the small fans are activated.

2.3 Monitoring system

The indoor air temperature $\theta_{\text{air},i}$ and the indoor air relative humidity (RH_i) were monitored using four sensors embedded in portable data loggers that were set with an acquisition time step of 30 minutes (HOBO U12, Onset Computer Corp., Pocasset, Mass.).

The outdoor weather conditions of $\theta_{\text{air},o}$ and relative humidity (RH_o) were monitored using a weather station that was set with an acquisition time step of 10 minutes (HOBO, Onset Computer Corp., Pocasset, Mass.). The daily value of Δp was obtained by the logged data in the farm automatic climate control system that manages the window openings to maintain a constant Δp on a daily basis.

The total horizontal solar irradiance ($I_{\text{tot,hor}}$) was obtained with a 30 minutes time step through a third-party weather station. The beam and diffuse components of the solar radiation were obtained using the model of Reindl, Beckman, and Duffie (1990).

The percentage of activation time of the nine large fans (ω_l) and the seven small ones (ω_s), were monitored with a time step of 90 s as described in Calvet, Cambra-López, Blanes-Vidal, Estellés, and Torres (2010). The measurement of gas concentration regarded NH_3 and CO_2 . A photoacoustic multi gas monitor equipped with a gas multiplexer was adopted in this work. This instrument enabled sequential measurements in 8 different points in a 2-hour time step (15 minutes are needed to complete each measurement). Four sampling points were placed next to the fans of the building at 1.2 m of height to determine the exhaust concentrations of the gas x ($C_{e,x}$), and two were placed at the air inlet openings for the characterization of gas concentration of the outside air ($C_{o,x}$). The remaining two measurement points were placed in the centre of the building at 1.2 m height to obtain further data on the distribution of gas concentrations ($C_{c,x}$) within the enclosure. The summary of the measured parameters is presented in Table 2, while the locations of the sensors inside the analysed broiler house is shown in Fig. 1.

Every week, 50 broilers (0.02% of the flock) were weighed for monitoring the trend of their live weight (w_b) during the experiment.

Table 2 – Detail of the monitored parameters.

| Monitored parameter | Symbol | Unit of measurement | Number of simultaneous measurements | Acquisition time step |
|---------------------|--------|---------------------|-------------------------------------|-----------------------|
|---------------------|--------|---------------------|-------------------------------------|-----------------------|

| | | | | |
|-----------------------------------|------------------|-------------------|----|------------|
| Activation time of large fans | ω_l | % | 1 | 90 seconds |
| Activation time of small fans | ω_s | % | 1 | 90 seconds |
| Outdoor air temperature | $\theta_{air,o}$ | °C | 1 | 10 minutes |
| Outdoor relative humidity | RH_o | % | 1 | 10 minutes |
| Indoor air temperature | $\theta_{air,i}$ | °C | 4 | 30 minutes |
| Indoor relative humidity | RH_i | % | 4 | 30 minutes |
| Total horizontal solar irradiance | $I_{tot,hor}$ | W m ⁻² | 1 | 30 minutes |
| Exhaust gas concentration | $C_{e,x}$ | ppm | 4 | 2 hours |
| Outdoor gas concentration | $C_{o,x}$ | ppm | 2 | 2 hours |
| Gas concentration (center) | $C_{c,x}$ | ppm | 2 | 2 hours |
| Static pressure difference | Δp | Pa | 1 | 1 day |
| Broiler live weight | w_b | kg | 50 | 1 week |

2.4 Calculation process

2.4.1 Estimation of the increased ventilation flow rate to fulfil the gas concentration requirements

In Fig. 2 the calculation process adopted in this work is resumed and the calculation steps are presented. In all the calculations, the monitored gas emissions are considered constant in the hourly time step.

At each hourly time step j , the indoor gas concentrations should be maintained below the established thresholds. This condition is expressed using the following inequation that must be fulfilled for both NH₃ and CO₂

$$\bar{C}_{i,x,j} \leq C_{lim,x} \quad (1)$$

where $\bar{C}_{i,x,j}$ is the average mass concentration of the analysed gas x (subscript x) inside the building (subscript i) at time step j . The value of $\bar{C}_{i,x,j}$ is the arithmetic mean between the average value of the two measured $C_{c,x,j}$, and the average value of the four measured $C_{e,x,j}$.

The term $C_{lim,x}$ is the mass concentration limit (subscript *lim*) of gas x .

If the constraint of Eq. (1) is respected, the actual ventilation flow rate of large ($\dot{V}_{l,j}$) and small ($\dot{V}_{s,j}$) fans is calculated on the basis of the real monitored data (ω_l , ω_s and Δp), according to the method described in Calvet, Cambra-López, Blanes-Vidal, Estellés, and Torres (2010).

The total actual ventilation flow rate ($\dot{V}_{l+s,j}$) is the sum of $\dot{V}_{l,j}$ and $\dot{V}_{s,j}$. The obtained values of

294 $\dot{V}_{l,j}$, $\dot{V}_{s,j}$ and $\dot{V}_{l+s,j}$ are used to calculate the fan electrical energy consumption ($E_{el,l+s}$) through
 295 the *SFP*, while the needed heating load ($\Phi_{H,j}$) and the thermal energy consumption for
 296 supplemental heating (E_{th}) are calculated through the energy simulation model.
 297 If the constraint of Eq. (1) is not respected, the theoretical increased ventilation flow rate
 298 ($\dot{V}'_{l+s,x,j}$) needed to guarantee $C_{lim,x}$ has to be calculated. At each time step j , $\dot{V}'_{l+s,x,j}$ depends
 299 on the gas emission rate from internal sources ($\dot{q}_{x,j}$), such as the reared broilers and the
 300 bedding material. At each time step j , $\dot{q}_{x,j}$ reads

$$\dot{q}_{x,j} = (\bar{C}_{i,x,j} - \bar{C}_{o,x,j}) \cdot \frac{m_x}{V_{mol,x}} \cdot \dot{V}_{l+s,j} \quad \left[\frac{mg_x}{h} \right] \quad (2)$$

301 where $\bar{C}_{o,x,j}$ (in ppm) is the average outdoor (subscript *o*) concentration of gas x at
 302 hourly time step j , obtained as the arithmetic mean between the two monitored values of $C_{o,x,j}$.
 303 m_x is the molecular mass of gas x that is equal to 0.017031 kg mol⁻¹ for NH₃ and
 304 0.04401 kg mol⁻¹ for CO₂. V_{mol} is the molar volume of gas x , that in this work is considered
 305 constant and equal to 0.02445 m³ mol⁻¹ for NH₃ and CO₂. $\dot{V}_{l+s,j}$ is the actual ventilation flow
 306 rate, calculated using the real monitored data calculated as previously stated. In Eq. (2), some
 307 simplifications are assumed, since $\dot{q}_{x,j}$ is considered constant and not influenced by the
 308 variation of the indoor environmental conditions in the considered time step j .
 309 Once estimated $\dot{q}_{x,j}$, $\dot{V}'_{l+s,x,j}$ is calculated through the following gas mass balance in steady-
 310 state conditions

$$\dot{V}'_{l+s,x,j} = \frac{\dot{q}_{x,j}}{C_{lim,x} - \bar{C}_{o,x,j}} \cdot \frac{V_{mol,x}}{m_x} \quad \left[\frac{m^3}{h} \right] \quad (3)$$

311 Eqs. (2) and (3) are applied at each time step of the analysed period for which the constraint
 312 of Eq. (1) is not respected. Considering NH₃ and CO₂ in Eqs. (2) and (3), $\dot{V}'_{l+s,NH_3,j}$ and
 313 $\dot{V}'_{l+s,CO_2,j}$ are obtained, respectively. At the time step j , the total theoretical ventilation flow
 314 rate ($\dot{V}'_{l+s,j}$) is calculated as

$$\dot{V}'_{l+s,j} = \max\{\dot{V}'_{l+s,NH_3,j}; \dot{V}'_{l+s,CO_2,j}\} \quad \left[\frac{m^3}{h} \right] \quad (4)$$

The obtained $\dot{V}'_{l+s,j}$ is split into the flow rate provided by large ($\dot{V}'_{l,j}$) and small fans ($\dot{V}'_{s,j}$) according to the control logic of the automatic climate control system of the broiler house (below 75,000 m³ h⁻¹ only small fans are activated). The obtained values of $\dot{V}'_{l+s,j}$, $\dot{V}'_{l,j}$ and $\dot{V}'_{s,j}$ are used to calculate the fan electrical energy consumption ($E'_{el,l+s}$), the theoretical heating load ($\Phi'_{H,j}$), the simulated indoor air temperature ($\theta'_{air,i}$) and the thermal energy consumption for heating (E'_{th}), as described in the following section.

2.4.2 Estimation of the electrical and thermal energy consumption

The estimation of the electrical energy consumption due to ventilation was carried out characterizing each fan model with the *SFP* curve. The *SFP* of a generic fan represents the energy needed by the fan to provide a cubic meter of airflow. For a generic fixed propeller speed fan, Costantino et al. (2018) expressed the *SFP* as a function of the static pressure difference between inside and outside of the house Δp as

$$SFP_{fan} = b_2 \cdot \Delta p^2 + b_1 \cdot \Delta p + b_0 \quad \left[\frac{\text{m}^3}{\text{Wh}} \right] \quad (5)$$

where b_2 , b_1 and b_0 are empirical coefficients that in this work are obtained by a regression from the technical datasheets of the fans.

Values of b_2 , b_1 and b_0 are presented in Table 3 for both fan models.

Table 3 – Regression coefficients b_2 , b_1 and b_0 for the *SFP* of both the fan models.

| Fan model | Coefficient | Value | Unit |
|------------|-------------|-------------------------|--|
| Large fans | $b_{l,2}$ | $-5.0000 \cdot 10^{-8}$ | m ³ Wh ⁻¹ Pa ⁻² |
| | $b_{l,1}$ | $+2.0250 \cdot 10^{-4}$ | m ³ Wh ⁻¹ Pa ⁻¹ |
| | $b_{l,0}$ | +0.0316 | [-] |
| Small fans | $b_{s,2}$ | 0 | m ³ Wh ⁻¹ Pa ⁻² |
| | $b_{s,1}$ | $+3.7110 \cdot 10^{-5}$ | m ³ Wh ⁻¹ Pa ⁻¹ |
| | $b_{s,0}$ | +0.0486 | [-] |

The electrical energy consumption due to the actual ventilation ($E_{el,l+s}$) of the analysed period is calculated as

$$E_{el,l+s} = \left[\sum_{j=1}^{967} \left(\frac{\dot{V}_{l,j}}{SFP_l} + \frac{\dot{V}_{s,j}}{SFP_s} \right) \right] \cdot 10^{-3} \quad [\text{kWh}_{el}] \quad (6)$$

where $\dot{V}_{l,j}$ and $\dot{V}_{s,j}$ are the actual ventilation flow rates provided the large and small fans at the time step j , SFP_l and SFP_s are the SFP of large and small fans respectively, and 967 is the number of hours of the analysed period.

In a similar way, the electrical energy consumption due to the increased ventilation ($E'_{el,l+s}$) is calculated as

$$E'_{el,l+s} = \left[\sum_{j=1}^{967} \left(\frac{\dot{V}'_{l,j}}{SFP_l} + \frac{\dot{V}'_{s,j}}{SFP_s} \right) \right] \cdot 10^{-3} \quad [\text{kWh}_{el}] \quad (7)$$

The estimation of the thermal energy consumption was carried out by the application of the dynamic energy simulation model developed by Costantino, Fabrizio, Ghiggini, and Bariani (2018). This model was specifically developed for mechanically ventilated broiler houses and is in compliance with ISO 13790 standard (2008). The adopted simulation model estimates the indoor environmental conditions ($\theta_{air,i}$ and RH_i) and the thermal and electrical energy consumption for climate control by solving a resistance–capacitance electrical network that is equivalent to the analysed building. The electrical network has 5 resistances and 1 capacitance (5R1C) and is solved using a finite difference method (Crank–Nicolson scheme) that analyses the 5R1C network with a time discretization of one hour. The reliability of the application of this model to broiler house was proven by previous works (Costantino et al., 2018; Costantino, Ballarini, Fabrizio, 2017).

In the framework of this paper, the energy simulation model of Costantino et al. (2018) is used for estimating the thermal energy consumption (E_{th}) considering the actual ventilation and the thermal energy consumption (E'_{th}) considering the theoretical ventilation needed to maintain C_{lim,NH_3} and C_{lim,CO_2} . The simulations were performed for the 967 hours of the monitoring period with an hourly time step.

To calculate E_{th} and E'_{th} , the boundary conditions of the analysed case study were inputted in the model, in particular:

- the geometrical and the thermophysical properties (e.g. U -values and κ_i) of the analysed broiler house;
- the farming features (e.g. stocking density and duration of the production cycle); the broiler weight was expressed as a function of the time based on the monitored data of w_b ;
- the outdoor weather conditions of $\theta_{air,o}$ and $I_{tot,hor}$ (obtained from a third-party weather station);
- the main features of the climate control system (e.g. control logic of the fans and η_H);
- the $\theta_{set,H}$ adopted in the case study (31 °C at the beginning and 18 °C at the end of the production cycle).

Finally, \dot{V}_{l+s} and \dot{V}'_{l+s} were input into the model to obtain E_{th} and E'_{th} , respectively.

3 Results and discussion

3.1 Analysis of the monitored data

In Fig. 3a, the hourly values of $\theta_{air,i}$ and $\theta_{air,o}$ during the monitored period are shown. The pattern of $\theta_{air,i}$ strictly followed the settings of the automatic control system of the farm and it can be considered similar to those obtained in other regions with different outdoor climate conditions (Jones, Donnelly, Stamp Dawkins, 2005.). At the beginning of the monitored period, (December 22nd, the 8th day of the production cycle) $\theta_{air,i}$ had an average daily value of around 27 °C; during the production cycle, $\theta_{air,i}$ gradually decreased reaching an average daily value of around 18 °C at the end of the production cycle (January 31st). This decreasing trend had an exception on January 19th, when $\theta_{air,i}$ was considerably higher than in the previous days. This $\theta_{air,i}$ peak was caused by $\theta_{air,o}$ that reached the highest value (26 °C) of the entire monitored period on that day. Before January 19th, the trend of $\theta_{air,o}$ was quite constant daily, and the average value of the period from December 22nd to January 18th was around 10 °C. After the peak of January 19th, $\theta_{air,o}$ remained higher than in the previous days with an average daily value of around 14.5 °C (January 19th – 21st). From January 22nd to the end of the monitored period, $\theta_{air,o}$ decreased to an average value of 7.6 °C.

The trend of the total actual ventilation flow rate \dot{V}_{l+s} during the monitored period is presented in Fig. 3b. From the beginning of the monitored period to January 18th, \dot{V}_{l+s}

gradually increased. On January 18th, a considerable increase in \dot{V}_{l+s} can be noticed and a peak of about 266,000 m³ h⁻¹ (the maximum monitored value of \dot{V}_{l+s}) occurred on January 19th, corresponding to the sudden increase of $\theta_{air,o}$. From January 22nd to the end of the production cycle, \dot{V}_{l+s} falls off due to the decrease of $\theta_{air,o}$ during the last days and due to the reduction of the number of broilers (15% of them was harvested on January 24th).

The actual ventilation flow rate can be expressed in air changes per hour (ach). During the monitored period, the minimum ventilation flow rate was around 1 ach, the maximum one was higher than 50 ach while the average was around 9 ach.

As stated before, intensive broiler farms usually are designed, equipped and operated to maintain the adequate indoor air temperature to ensure an optimum animal development but, on the contrary, farm installations are not usually designed and operated to maintain established NH₃ and CO₂ concentration levels. Consequently, concentration thresholds are normally exceeded in winter periods, when ventilation rates are low, as evidenced by Groot Koerkamp et al. (1998) and by the monitored emission trend presented in Fig. 3c and d.

In Fig. 3c, the monitored NH₃ mass concentration is presented. During the analysed period, \bar{C}_{o,NH_3} remained quite constant with an average value (during the entire period) lower than 1 ppm. \bar{C}_{i,NH_3} had an average value of 18.3 ppm (the minimum was 1.4 ppm, the maximum 38.1 ppm) but it varied considerably and exceeded the threshold mainly in the central portion of the monitored period. Although this tendency is also described in literature (Knížatová et al., 2010), the evolution of NH₃ concentration is, to some extent, hard to predict, being influenced by litter management, environmental conditions, ventilation rates and broiler health status (Weaver and Meijerhof, 1991). In Fig. 3c it stands out that during the first days, \bar{C}_{i,NH_3} was considerably below the \bar{C}_{lim,NH_3} but, later, it sudden increased since the chicks were growing and because the excreta quantity in the bedding material increased over time, affecting the NH₃ emissions. From December 28th to January 18th, \bar{C}_{i,NH_3} remained higher than \bar{C}_{lim,NH_3} for most of the time. After January 18th to the end of the production cycle, the increased \dot{V}_{l+s} (due to the high values of $\theta_{air,o}$) improved the indoor environmental conditions in terms of gas concentration, and \bar{C}_{i,NH_3} decreased below \bar{C}_{lim,NH_3} for most of the time. The reduction of the animal stocking density inside the house of January 24th may have partially affected this decrease.

Despite CO₂ production from broilers and manure increases as broilers grow (Calvet, Estelles, Cambra-Lopez, Torres, Van den Weghe, 2011), CO₂ concentrations inside the house followed

a decreasing trend in the analysed period due to the diluting effect of increasing ventilation rates. During the first days of the monitored period, \bar{C}_{i,CO_2} had higher values than in the remaining days and was considerably higher than C_{lim,CO_2} , as shown in Fig. 3d. This difference was due to the need to maintain $\theta_{set,H}$ during the first days of the production cycle. Combining the high temperature needs of broilers during their first days of life with their low sensible thermal emission, supplemental heating had to be provided to reach $\theta_{set,H}$. The supplemental heating was provided by propane air heaters that emitted the exhaust fumes directly inside the enclosure, increasing $\theta_{air,i}$ and \bar{C}_{i,CO_2} . During these days (December 22nd – January 6th), \dot{V}_{1+s} was at minimum values (below 50,000 m³ h⁻¹) and the CO₂ in the house could not be diluted through the ventilation. When $\theta_{set,H}$ was maintained without the supplemental heating, \bar{C}_{i,CO_2} decreased considerably and after January 6th remained stably below C_{lim,CO_2} . During the monitored period, the average value of \bar{C}_{i,CO_2} was 2,517 ppm (the minimum was 819 ppm, the maximum 5,765 ppm), while the average value of \bar{C}_{i,CO_2} was around 480 ppm and it was almost constant. The outdoor concentration \bar{C}_{o,CO_2} had a mean value of 484 ppm during the monitoring period, with the minimum value of 430 ppm and the maximum one of 763 ppm.

The absolute and cumulative frequencies of \bar{C}_{i,NH_3} and \bar{C}_{i,CO_2} are presented in Fig. 4a and b, respectively. Comparing the trends of the two cumulative frequencies, the control of \bar{C}_{i,NH_3} appears more problematic than the control of \bar{C}_{i,CO_2} . Analysing separately the concentrations of NH₃ and CO₂, it stands out that 43% of the \bar{C}_{i,NH_3} values are above 20 ppm, while around 30% of the \bar{C}_{i,CO_2} values result above 3,000 ppm. Considering the analysed gas concentration together, \bar{C}_{i,NH_3} and \bar{C}_{i,CO_2} are below their thresholds only for 40% of the monitored time, therefore for 60% of time the gas concentration limits were not respected in the monitored broiler house.

The negative effects of a stressor on the animal's welfare are dependent on both its severity and its duration (Gerritzen, Lambooi, Hillebrand, Lankhaar, Pieterse, 2000; Ritz, Fairchild, Lacy, 2004). Although acute exposure to lethal concentrations of gases may occur in livestock buildings, the effects of chronic exposure are more insidious (Wathes and Charles, 1994). For example, a long exposure to NH₃ (around 42 days) at 20 ppm (the concentration limit) may cause pulmonary congestion, oedema and haemorrhage (Anderson, Beard, Hanson 1964; Quarles and Kling, 1974). Broilers exposed to 25 and 50 ppm of NH₃ concentration for 35

days increased the respiratory rate, the haemoglobin and haematocrit, which could indicate an increase in the metabolic activity to meet energy demands under stressful situations (Olanrewaju et al., 2007). For this reason, it is important to consider both the concentration values and the exposure time. In Table 4, the number of events (periods of time in which the gas concentration limit is continuously exceeded) and their duration (time in which the gas concentration is continuously above the established limit) are reported. The number of events in which C_{lim,NH_3} was exceeded in the monitored period was 30. About half of these events (14) lasted less than 8 hours with maximum \bar{C}_{i,NH_3} values lower than 27 ppm, while 11 events lasted more than 18 hours reaching concentration values considerably higher than C_{lim,NH_3} (e.g. 36.5 and 38.1 ppm). Such high concentration may have a deleterious effect on growth (Beker et al., 2004; Valentine, 1964; Quarles and Kling, 1974), may cause alterations in blood physiological parameters (Olanrewaju et al., 2007) and aversion to atmospheres (Kristensen, Burgess, Demmers, Wathes, 2000; Wathes, Jones, Kristensen, Jones, Webster, 2002). The number of events in which \bar{C}_{i,CO_2} exceeded C_{lim,CO_2} was 12: in 5 of them the duration was higher than 18 hours with concentrations considerably higher than the limit (up to 5,796 ppm of maximum value). These high concentrations can be considered tolerated by broilers if intermittent (Verstegen, Tamminga, Greers, 1994), otherwise they represent a risk for the animal health. According to literature, it seems easy for most of the farms to maintain CO_2 levels below the limits that can cause damages to the broilers (Olanrewaju et al., 2008). The results reported in Fig. 4 and Table 4 confirm what stated in literature; in the analysed case study the control of CO_2 concentration was easier than the one of NH_3 .

Table 4 – Number of events and duration in which the indoor average NH_3 (\bar{C}_{i,NH_3}) and CO_2 (\bar{C}_{i,CO_2}) concentrations exceeded the established thresholds.

| Duration [h] | NH ₃ | | CO ₂ | |
|-----------------|------------------|-------------------------------------|------------------|-------------------------------------|
| | Number of events | Maximum \bar{C}_{i,NH_3} [ppm] | Number of events | Maximum \bar{C}_{i,CO_2} [ppm] |
| From 2 to 4 | 7 | 22.3 | 2 | 3,121 |
| From 6 to 8 | 7 | 27.0 | 1 | 3,101 |
| From 10 to 12 | 1 | 22.0 | 1 | 3,178 |
| From 14 to 16 | 4 | 33.1 | 3 | 3,508 |
| From 18 to 20 | 9 | 36.5 | 2 | 4,113 |
| From 22 to 24 | 0 | - | 2 | 4,744 |
| More than 24 | 2 | 38.1 | 1 | 5,796 |

| | | |
|-------|----|----|
| Total | 30 | 12 |
|-------|----|----|

3.2 Evaluation of the theoretical ventilation increase

As described in the previous sections, during the monitored period, the thresholds of NH_3 and CO_2 were exceeded repeatedly, with various time durations. In the case study, the adopted strategy to reduce those concentrations is to increase the ventilation rate. In other words, gas concentrations were used as additional control parameters of ventilation (in addition to $\theta_{\text{air},i}$ that is commonly used), and the required ventilation was modelled assuming a constant emission rate of NH_3 and CO_2 . Although other options are also available, this strategy may be the most readily convenient for a farmer. A critical assumption of the approach in this study is that gas emissions do not differ for different ventilation rates. Despite it is known that NH_3 emissions are affected by airflow rates and patterns (Morsing, Strom, Zhang, Kai, 2008), the effect of changing ventilation rate on gas emissions is unclear in research. On the one hand, Knížatová et al. (2010) suggested that higher ventilation is the reason of increased emissions in summer. However, higher ventilation rates at certain air temperature and relative humidity also contribute to litter drying thus reducing the emission of NH_3 (Weaver and Meijerhof, 1991). There is no evidence of variations in CO_2 emissions due to changes in ventilation rates, and therefore the hypothesis of constant emission of this gas seems adequate. Furthermore, the variation in percentage between \dot{V}_{1+s} and \dot{V}'_{1+s} is generally small, being lower than 60% in 90% of the considered time steps. In the primary axis of Fig. 5 the relative variation between \dot{V}'_{1+s} and \dot{V}_{1+s} is shown expressed as a percentage. From the graph it stands out that during the first days the difference in percentage is higher than in the following ones, reaching its maximum value (116%). After the first days, the difference decreases, and a further increase can be noticed in the half of the monitored period. To better understand the trend of the increased ventilation flow rate, the absolute variation between \dot{V}'_{1+s} and \dot{V}_{1+s} ($\Delta\dot{V}'_{1+s}$) is analysed. This trend is reported in the secondary axis of Fig. 5 and it is expressed in $\text{m}^3 \text{h}^{-1}$. The graph shows that $\Delta\dot{V}'_{1+s}$ is higher from January 7th to 18th, when peaks that exceed 25,000 $\text{m}^3 \text{h}^{-1}$ are present. These considerable values of $\Delta\dot{V}'_{1+s}$ depend on the increase of \bar{C}_{i,NH_3} that characterizes those days (as reported in Fig. 3c). From January 19th to the end of the cycle, $\Delta\dot{V}'_{1+s}$ is not needed because higher values of \dot{V}_{1+s} were monitored due to the increase of $\theta_{\text{air},o}$. The only exception is from January 24th to 30th when the decrease of $\theta_{\text{air},o}$ entails a reduction in \dot{V}_{1+s} that is not enough to maintain \bar{C}_{i,NH_3} below the established limit.

From the beginning of the monitored period to January 6th, $\Delta\dot{V}'_{l+s}$ values rarely exceed 10,000 m³ h⁻¹. These increases in ventilation are needed to dilute the high CO₂ concentration of those day that are caused by the low values of \dot{V}_{l+s} and the activation of the propane air heaters that emit exhaust fumes directly inside the house.

In this work, the increased ventilation flow rate was calculated considering each gas emission \dot{q}_x constant and not influenced by the variation of the indoor environmental conditions. A future improvement of the present work may involve the evaluation of the theoretical increase of the ventilation flow rate considering a not constant gas emission but considering different parameters that influence NH₃ and CO₂ emissions, such as the litter conditions.

In the present work, the extra ventilation flow rate to control gas concentration was calculated considering that the extra supplemental heat needed to maintain $\theta_{set,H}$ is provided by systems that do not emit exhaust fumes inside the house and, consequently, do not further increase the CO₂ concentration. Anyway, it was verified that if the supplemental heat would be provided by the same propane heaters that are present inside the analysed livestock house, the emitted exhaust fumes are estimated to increase the CO₂ concentration by less than 3% on average.

This is because the CO₂ emissions from broilers are considerably higher than the one from the propane air heaters.

3.3 Evaluation of the energy consumptions

The analysis shows that during the monitored period around 41,900,000 m³ of fresh air were provided by the fans to the broiler house. To maintain the required gas concentration during all the monitored period, around 45,800,000 m³ of fresh air are theoretically needed, an increase by about 9.3%. This increase in ventilation flow rate makes it possible to respect the established gas concentration threshold but, at same time, entails a rise of the energy consumption of both electrical energy (for operating the fans) and thermal energy (for maintaining $\theta_{set,H}$). In Table 5 the thermal and electrical energy consumption considering \dot{V}_{l+s} and \dot{V}'_{l+s} are presented and compared. From the table it stands out that considering the increased ventilation, the electrical energy consumption rises from 1,946 kWh_{el} ($E_{el,l+s}$) to 2,137 kWh_{el} ($E'_{el,l+s}$), an increase by 9.8%. Focusing on the share of the electrical energy consumption of large and small fans, the table shows that, on the one hand, the electrical energy consumption of the small fans increases by about 11.5%, rising from 1,689 kWh_{el} ($E_{el,s}$) to 1,883 kWh_{el} ($E'_{el,s}$). On the other hand, the electrical energy consumption due to the

operation of large fans slightly decreases by 1.2%, from 257 kWh_{el} ($E_{el,l}$) to 254 kWh_{el} ($E'_{el,l}$). This slight decrease depends on the control logic that is set in the climate control system for activating the fans. Most of the estimated values of \dot{V}'_{l+s} , in fact, are below the threshold of activation of the large fans (75,000 m³ h⁻¹) and the increased ventilation flow rate is provided almost only by the small fans which energy consumption increases. Little differences between the real control logic of the fans and the modelled one may exist, and they may slightly affect the results.

The increase of ventilation air flow rate entails also an increase in the thermal energy consumption for heating, as reported in Table 5. During the monitored period, the energy simulation model estimates E_{th} to be around 31,816 kWh_{th}, while considering \dot{V}'_{l+s} , E'_{th} becomes 36,190 kWh_{th}, an increase by 13.7%.

Table 5 – Comparison between the electrical (E_{el}) and thermal energy consumption (E_{th}) considering the actual ventilation flow rate (\dot{V}_{l+s}) and the electrical (E'_{el}) and thermal energy consumption (E'_{th}) considering the increased ventilation flow rate (\dot{V}'_{l+s}).

| Energy consumption considering \dot{V}_{l+s} | Energy consumption considering \dot{V}'_{l+s} | Difference in percentage |
|--|--|--------------------------|
| ¹ $E_{el,l}$ 257 kWh _{el} | $E'_{el,l}$ 254 kWh _{el} | -1.2% |
| ² $E_{el,s}$ 1,689 kWh _{el} | $E'_{el,s}$ 1,883 kWh _{el} | +11.5% |
| $E_{el,l+s}$ 1,946 kWh _{el} | $E'_{el,l+s}$ 2,137 kWh _{el} | +9.8% |
| E_{th} 31,816 kWh _{th} | E'_{th} 36,190 kWh _{th} | +13.7 |

¹ l = large fans

² s = small fans

The increase in thermal energy consumption is focused especially on the central part of the analysed period, as shown in Fig. 6 where the heating load needed considering \dot{V}_{l+s} (Φ_H) and the theoretical heating load considering \dot{V}'_{l+s} (Φ'_H) are shown on the primary axis. The monitored value of $\theta_{air,i}$, the values of $\theta_{set,H}$, $\theta_{set,C}$ and the simulated indoor air temperature ($\theta'_{air,i}$) are displayed on the secondary axis of the same graph. The analysis of the heating loads shows that the Φ_H does not reach 170 kW, that is the maximum heating load capacity of the two propane air heaters of the broiler house. The average value of Φ_H was estimated to be

around 33 kW, with a maximum value of around 94 kW. The average value of Φ'_H is not far from the one of Φ_H , being around 37 kW, but the charts shows that Φ'_H trend is characterized by some peaks that are not present in Φ_H trend, especially from January 7th to 18th, when the highest values of $\Delta\dot{V}'_{l+s}$ were estimated. The Φ'_H peaks exceed the threshold of 170 kW (the maximum heat capacity of the two air heaters), reaching a value around 227 kW. It means that, adopting \dot{V}'_{l+s} as ventilation profile, the propane gas heaters would not be able to maintain the established $\theta_{set,H}$ during few hours of the monitored period. This aspect represents a further issue in increasing the ventilation flow rate to control gas concentration beyond the increase in energy consumption since in an existing broiler house, it may happen that the existing climate control system (air heaters and fans) would not be sized and designed to provide the needed ventilation flow rate and/or to the adequate heating load when NH_3 and CO_2 concentrations should be controlled.

Analysing the indoor air temperatures, the graph highlights that even though $\theta_{air,i}$ tends to fluctuate between $\theta_{set,H}$ and $\theta_{set,C}$ more than $\theta'_{air,i}$, the two trends are quite similar. Both $\theta_{air,i}$ and $\theta'_{air,i}$ increase considerably over $\theta_{set,C}$ on January 19th when the peak of $\theta_{air,o}$ was monitored. On January 24th, the trends of $\theta_{air,i}$ and $\theta'_{air,i}$ differ relevantly. This difference is due to the broiler harvesting operations of that day that increase the ventilation flow rate (due to door opening) decreasing $\theta_{air,i}$. This increase in the ventilation flow rate is not considered by the energy simulation model that, consequently, underestimates $\theta'_{air,i}$.

As stated before, the production of the analysed cycle was 23,212 broilers with a final live weight of 62,534 kg. Considering a carcass yield of 73% (as stated in Costantino, Fabrizio, Biglia, Cornale and Battaglini, 2016) a total meat production of roughly 45,650 kg is estimated. Expressing $E_{el,l+s}$ and E_{th} per unit of final product (kg_{meat}), values of 43 $Wh_{el} kg_{meat}^{-1}$ and 697 $Wh_{th} kg_{meat}^{-1}$ can be calculated, respectively. These values are comparable to the average ones found by Costantino et al., 2016, that estimated a specific energy consumption to produce a kg of broiler meat between 20 and 45 Wh_{el} for ventilation and between 380 and 760 Wh_{th} for heating. Considering the increase in ventilation, the previously mentioned values would increase up to 47 Wh_{el} and 793 Wh_{th} , but further analysis should be carried out for investigating how the improvement in the IAQ conditions may increase the meat production, entailing a consequent reduction of the specific energy consumption values.

In Fig. 7 the total primary energy consumption and the share due to heating and ventilation are shown for both the actual and the increased ventilation flow rates. To convert the electrical and thermal energy into primary energy, the following total conversion factors (renewable plus non-renewable energy) of Spain were used (Resolución conjunta de los Ministerios de Industria, Energía y Turismo, y Ministerio de Fomento, 2014):

- $f_{p,tot}=2.403$ [kWh_p kWh_{el}⁻¹] for the electrical energy from the grid;
- $f_{p,tot}=1.195$ [kWh_p kWh_{th}⁻¹] for the natural gas.

The chart shows that the primary energy consumption considering the actual ventilation flow rate is estimated to be about 42,696 kWh_p with 12% (4,676 kWh_p) due to ventilation and the remaining 88% (38,020 kWh_p) due to heating. Increasing the ventilation flow rate, the primary energy consumption reaches 48,383 kWh_p with similar shares of energy for ventilation 5,135 kWh_p (9%) and heating 43,248 kWh_p (91%). The increase of the ventilation flow rate entails an increase by 13% in terms of total primary energy.

A last consideration concerns the financial implications of increasing the ventilation flow rate to maintain the gas concentrations below the established thresholds. Assuming a cost for the electrical energy in Spain equal to 0.14 € kWh_{el}⁻¹ (EUROSTAT, 2019) and 0.08 € kWh_{th}⁻¹ for the thermal energy from propane (IDAE, 2019) (both costs are considered excluding taxes), the total cost for climate control considering the actual ventilation flow rate is estimated to be 2,818 €, meaning around 0.117 € per harvested broiler. Increasing the ventilation flow rate, the production cost due to the energy for climate control will increase up to 3,194 € (0.133 € per broiler), an increase by 14%.

4 Conclusions

In this work, the variation of the energy consumption due to the increase of ventilation for maintaining NH₃ and CO₂ concentrations below established thresholds (20 and 3,000 ppm, respectively) were evaluated. A winter growing cycle of broilers in a Mediterranean broiler farm was used as a case study.

In the monitored case study, NH₃ and CO₂ concentrations were both below the established thresholds at the same time during 40% of time. The control of CO₂ concentration represented a major issue during the first part of the analysed period, while the control of NH₃ concentration was relevant during the central part of the production cycle.

To maintain the desired gas concentration, the ventilation flow rate needed to be increased by around 9%. This resulted in electrical energy consumption increasing around 10% (from

1,946 to 2,137 kWh_{el}), while the thermal energy increased roughly by 14%, rising from 31,816 kWh_{th} to 36,190 kWh_{th}. The additional energy cost to maintain the gas concentration below the thresholds was estimated to be 376 € (+14%).

The methodology presented here can be used for other situations (e.g. different farm designs and climate conditions) but specific technical limitations of existing farms to provide higher ventilation rates (limited capacity of fans and heaters) should be considered. This work may be improved implementing in the adopted simulation model the short-and long-term effects of changing ventilation on NH₃ and CO₂ emissions.

5 Acknowledgements

This work was supported by the Spanish Ministry of Science and Innovation [Project GASFARM-2 AGL2008-04125].


6 References

- ASHRAE. (2016). Standard 90.1-2016. *Energy Standard for Buildings Except Low-Rise Residential Buildings*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.
<https://doi.org/http://dx.doi.org/10.1108/17506200710779521>
- Anderson, D.P., Beard, C.W., & Hanson, R.P. (1964). The adverse effects of ammonia on chickens including resistance to infection with Newcastle disease virus. *Avian Research*, 8, 369-379.
- Beker, A., Vanhooser, S.L., Swartzlander, J.H., & Teeter, R.G. (2004). Atmospheric Ammonia Concentration Effects on Broiler Growth and Performance. *The Journal of Applied Poultry Research*, 13, 5-9.
- Calvet, S., Cambra-López, M., Blanes-Vidal, V., Estellés, F., & Torres, A.G. (2010). Ventilation rates in mechanically-ventilated commercial poultry buildings in Southern Europe: Measurement system development and uncertainty analysis. *Biosystems Engineering*, 106, 423-432.
- Calvet, S., Estelles, F., Cambra-Lopez, M., Torres, A.G., & Van den Weghe, H.F.A. (2011). The influence of broiler activity, growth rate, and litter on carbon dioxide balances for the determination of ventilation flow rates in broiler production. *Poultry Science*, 90, 2449-2458.
- Costantino, A., Fabrizio, E., Biglia, A., Cornale, P., & Battaglini, L. (2016). Energy use for climate control of animal houses: the state of the art in Europe. *Energy Procedia*, 101, 184-191.
- Costantino, A., Ballarini, I., & Fabrizio, E. (2017). Comparison between simplified and detailed methods for the calculation of heating and cooling energy needs of livestock housing: a case study. *Proceedings of the 3rd IBPSA-Italy Conference*. Bozen-Bolzano, Italy, February 8th-10th, 2017.
- Costantino, A., Fabrizio, E., Ghiggini, A., and Bariani, M. (2018). Climate control in broiler houses: A thermal model for the calculation of the energy use and indoor environmental conditions. *Energy & Buildings*, 169, 110–126.

- Costantino, A., & Fabrizio, E. (2020). *Introduction to Biosystems Engineering* (N. M. Holden, M. L. Wolfe, J. A. Ogejo, & E. J. Cummins, eds.). Blacksburg, Virginia: ASABE, VT Publishing (in press).
- European Committee for Standardisation. *EN ISO 15927-6: Hygrothermal performance of buildings - Calculation and presentation of climatic data.*, CEN § (2007).
- European Council. (2007) Laying down minimum rules for the protection of chickens kept for meat production, Dir. 2007/43/CE, 28th June 2007.
- EUROSTAT (2019). <https://urlzs.com/LEao5>. Accessed in May 2019.
- FAO- Food and Agriculture Organization of the United Nations. (2011). *Energy-smart food for people and climate – Issue Paper*. Rome, Italy: FAO.
- Gerritzen, M.A., Lambooij, E., Hillebrand, S.J., Lankhaar, J.A., & Pieterse, C. (2000). Behavioral responses of broilers to different gaseous atmospheres. *Poultry Science* 79, 928-933.
- Gerritzen, M., Lambooij, B., Reimert, H., Stegeman, A., & Spruijt, B. (2007). A note on behaviour of poultry exposed to increasing carbon dioxide concentrations. *Applied Animal Behaviour Science*, 108 (1–2), 179–185.
- Groot Koerkamp, P.W.G.G., Metz, J.H.M., Uenk, G.H., Phillips, V.R., Holden, M.R., Sneath, R.W., Short, J.L., White, R.P., Hartung, J., Seedorf, J., Schroder, M., Linkert, K.H., Pedersen, S., Takai, H., Johnsen, J.O., & Wathes, C.M. (1998). Concentrations and emissions of ammonia in livestock buildings in Northern Europe. *Journal of Agricultural Engineering Research*, 70, 79-95.
- Gustin, P., Urbain, B., Prouvost, J.F., & Ansay, M. (1994). Effects of Atmospheric Ammonia on Pulmonary Hemodynamics and Vascular-Permeability in Pigs - Interaction with Endotoxins. *Toxicology and Applied Pharmacology* 125, 17-26.
- IDAE (Instituto para la Diversificación y ahorro de la Energía). (2019). *Informe de precios energéticos: combustibles y carburantes - Datos a 25 de marzo de 2019*.
- ISO- International Standard Organization. (2008). *Standard ISO 13790:2008. Energy performance of buildings - Calculation of energy use for space heating and cooling*.
- ISO- International Standard Organization. (2017a). *Standard ISO 6946:2017. Building components and building elements - Thermal resistance and thermal transmittance - Calculation methods*.
- ISO- International Standard Organization. (2017b). *Standard ISO 13786:2017. Thermal performance of building components -- Dynamic thermal characteristics -- Calculation methods*.
- Jones, T.A., Donnelly, C.A., & Stamp Dawkins, M. (2005). Environmental and Management Factors Affecting the Welfare of Chickens on Commercial Farms in the United Kingdom and Denmark Stocked at Five Densities. *Poultry Science*, 84, 1155-1165.
- Knížatová, M., Mihina, Š., Broucek, J., Karandušová, I., Sauter, G.J., & Macuhová, J. (2010). Effect of the age and season of fattening period on carbon dioxide emissions from broiler housing. *Czech Journal of Animal Science*, 55, 436-444.
- Kristensen, H.H., Burgess, L.R., Demmers, T.G.H., & Wathes, C.M. (2000). The preferences of laying hens for different concentrations of atmospheric ammonia. *Applied Animal Behaviour Science*, 68, 307-318.
- McGovern, R.H., Feddes, J.J.R., Zuidhof, M.J., Hanson, J.A., & Robinson, F.E. (2001). Growth performance, heart characteristics and the incidence of ascites in broilers in response to carbon dioxide and oxygen concentrations. *Canadian Biosystems Engineering*, 43, 41-46.

- Morsing S., Strom J.S., Zhang G., & Kai, P. (2008). Scale model experiments to determine the effects of internal airflow and floor design on gaseous emissions from animal houses. *Biosystems Engineering*, 99, 99-104.
- Olanrewaju, H. A., Miller, W. W., Maslin, W. R., Thaxton, J. P., Dozier, W. A., Purswell, J., & Branton, S. L. (2007). Interactive effects of ammonia and light intensity on ocular, fear and leg health in broiler chickens. *International Journal of Poultry Science*, 6, 762-769.
- Olanrewaju, H.A., Dozier, W.A., Purswell, J.L., Branton, S.L., Miles, D.M., Lott, B.D., Pescatore, A.J., & Thaxton, J.P. (2008). Growth Performance and Physiological Variables for Broiler Chickens Subjected to Short-Term Elevated Carbon Dioxide Concentrations. *International Journal of Poultry Science*, 7, 738-742.
- Oviedo-Rondón, E.O. (2010). Ahorro energético en granjas avícolas (Energy savings in poultry farms, in Spanish). *Proceedings of the XLII Symposium científico de avicultura*. Zaragoza, Spain, October 29th-November 2nd, 2009.
- Quarles, C.L., and Kling, H.F. (1974). Evaluation of Ammonia and Infectious Bronchitis Vaccination Stress on Broiler Performance and Carcass Quality. *Poultry Science*, 53, 1592-1596.
- Reindl, D.T., Beckman, W.A., & Duffie, J.A. (1990). Diffuse Fraction Correlations. *Solar Energy*, 45 (1), 1-7. [https://doi.org/10.1016/0038-092X\(90\)90060-P](https://doi.org/10.1016/0038-092X(90)90060-P).
- Resolución conjunta de los Ministerios de Industria, Energía y Turismo, y Ministerio de Fomento (2014). *Factores de emisión de CO₂ y coeficientes de paso a energía primaria de diferentes fuentes de energía final consumidas en el sector de edificios en España*.
- Ritz, C.W., Fairchild, B.D., & Lacy, M.P., (2004). Implications of ammonia production and emissions from commercial poultry facilities: A review. *Journal of Applied Poultry Research*, 13, 684-692.
- Thornton, P.K. (2010). Livestock production: recent trends, future prospects. *Philosophical Transactions of the Royal Society B (Biological Sciences)*, 365, 2853–2867.
- Valentine, H. (1964). A study of the effect of different ventilation rates on the ammonia concentrations in the atmosphere of broiler houses. *British Poultry Science*, 5, 149-159.
- Verspecht, A., Vanhonacker, F., Verbeke, W., Zoons, J., & Van Huylenbroeck, G. (2011). Economic impact of decreasing stocking densities in broiler production in Belgium. *Poultry Science*, 90, 1844-1851.
- Verstegen, M.W.A., Tamminga, S., & Greers, R., (1994). The effect of gaseous pollutants on animals. In I.Ap. Dewi, R.F.E. Axford, I. Fayed M. Marai, & H. Omed (Eds.), *Pollution in livestock production systems* (pp. 71-79). Oxon: CAB International.
- Wathes, C.M., & Charles, D.R. (1994). *Livestock Housing, I*. Wallingford: CAB International.
- Wathes, C.M., Jones, J.B., Kristensen, H.H., Jones, E.K.M., & Webster, A.J.F. (2002). Aversion of pigs and domestic fowl to atmospheric ammonia. *Transactions of the ASAE*, 45, 1605-1610.
- Weaver, W.D., & Meijerhof, R. (1991). The effect of different levels of relative-humidity and air movement on litter conditions, ammonia levels, growth, and carcass quality for broiler-chickens. *Poultry Science*, 70, 746-755.
- Yi, B., Chen, L., Sa, R., Zhong, R., Xing, H. & Zhang, H. (2016). Transcriptome profile analysis of breast muscle tissues from high or low levels of atmospheric ammonia exposed broilers (gallus gallus). *PloS one*, 11(9), p.e0162631.

- 735 Zhang, Y., and Barber, E.M. (1995). An Evaluation of Heating and Ventilation Control Strategies for Livestock
736 Buildings. *Journal of Agricultural Engineering Research*, 60, 217-225.

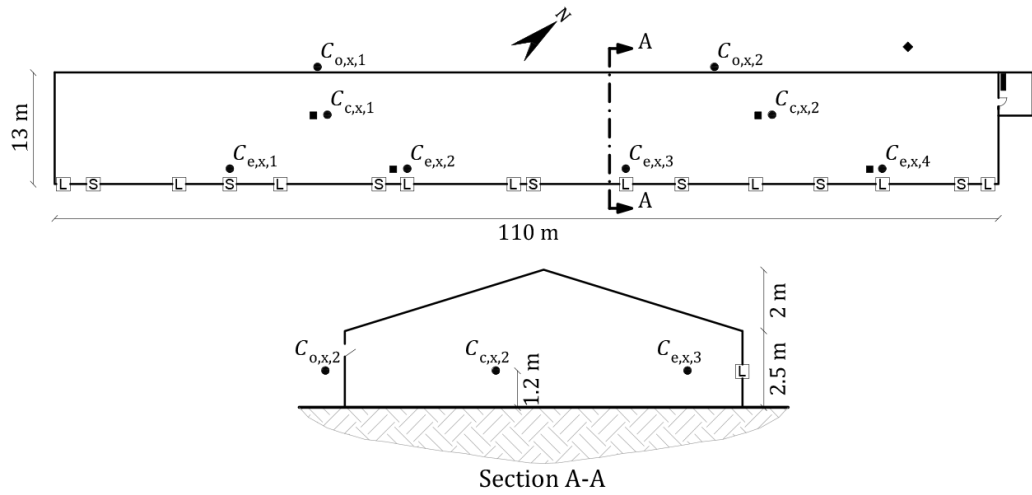

Legend

- Large fan
- Small fan
- Outdoor air temperature and relative humidity sensor
- Indoor air temperature and relative humidity sensor
- Gas concentration (C_x) sensor
- Automatic climate control system

Fig. 1. Position of the sensors inside the broiler house. The figure shows also the main geometrical dimensions of the analysed house. Plan and cross section view (not at the same scale).

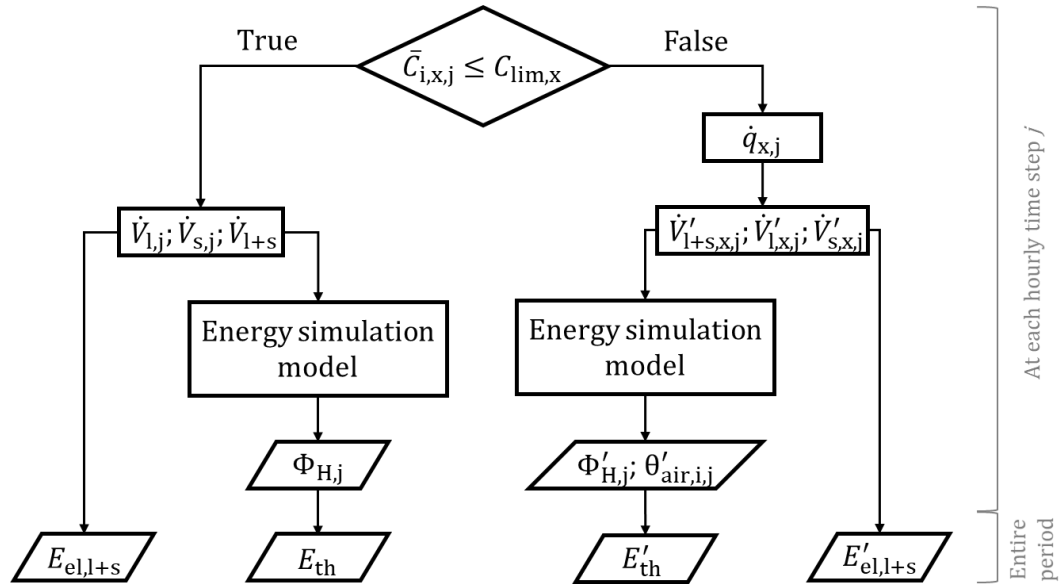


Fig. 2. Flow chart of the calculation process.

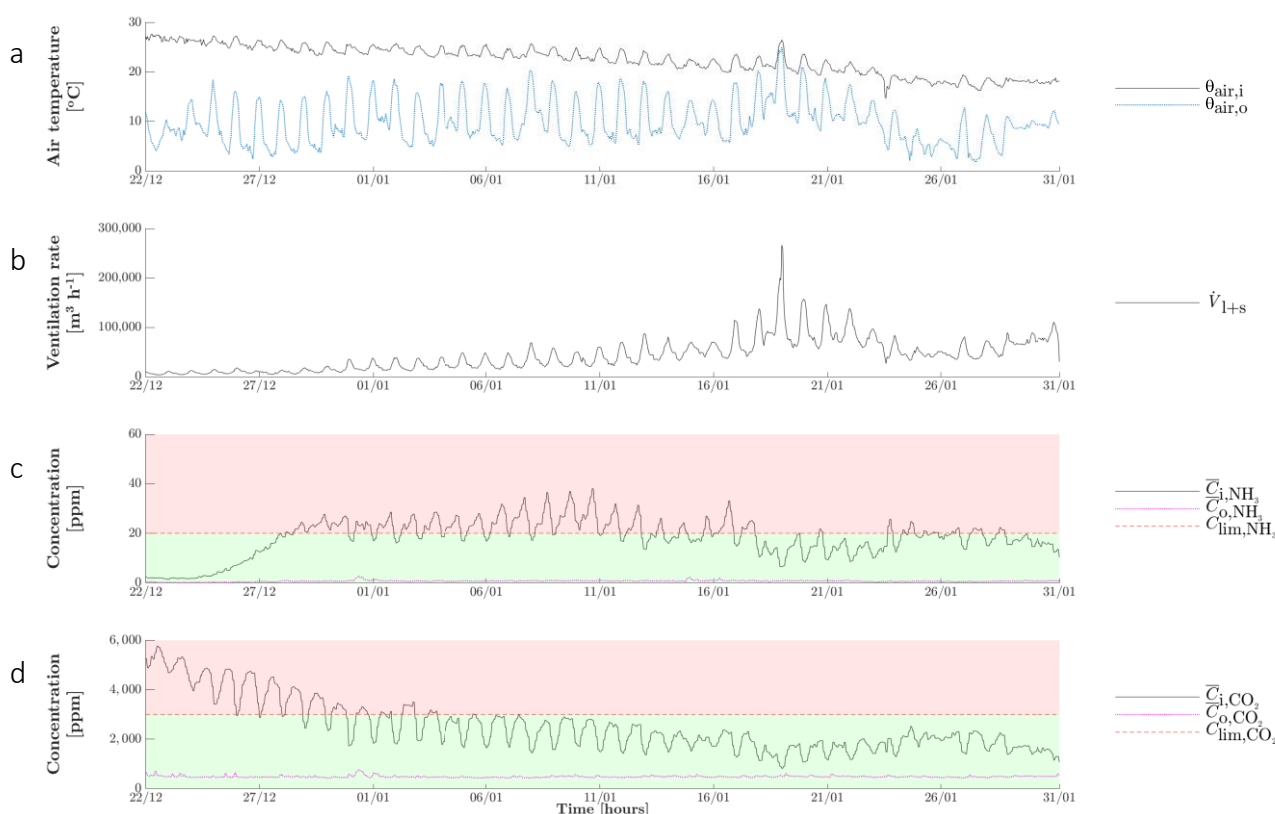


Fig. 3. a) monitored indoor $\theta_{air,i}$ and outdoor $\theta_{air,o}$ air temperatures;

b) actual total ventilation flow rate \dot{V}_{l+s} ;

c) monitored indoor (\bar{C}_{i,NH_3}) and outdoor (\bar{C}_{o,NH_3}) NH_3 concentrations and indoor concentration limit (C_{lim,NH_3});

d) monitored indoor (\bar{C}_{i,CO_2}) and outdoor (\bar{C}_{o,CO_2}) CO_2 concentrations and indoor concentration limit (C_{lim,CO_2}).

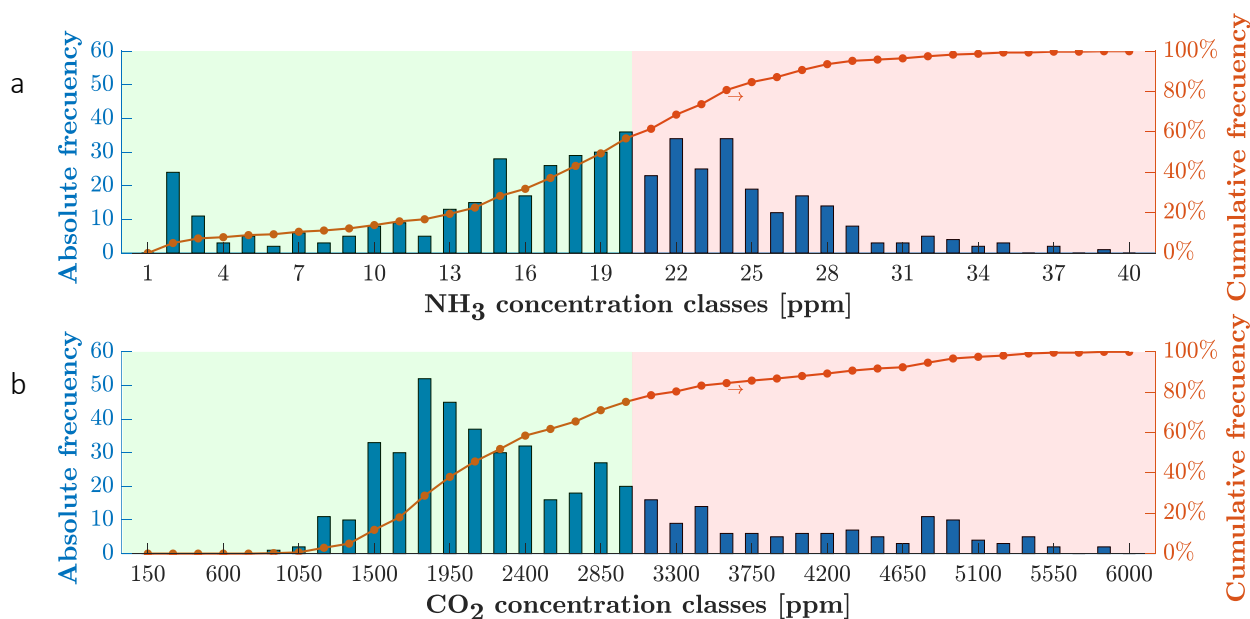


Fig. 4. Absolute and cumulative frequencies of:

a) monitored indoor average NH_3 concentration (\bar{C}_{i,NH_3});

b) monitored indoor average CO₂ concentration (\bar{C}_{i,CO_2})
(arrows indicate the reference axis).

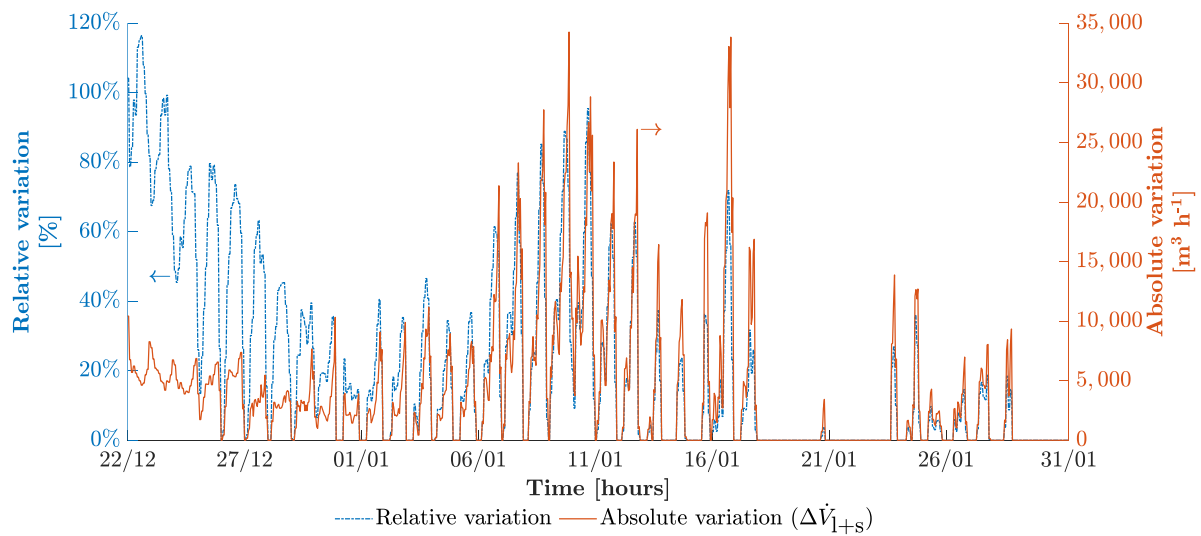


Fig. 5. Relative and absolute ventilation variation ($\Delta\dot{V}'_{l+s}$) between increased (\dot{V}'_{l+s}) and actual (\dot{V}_{l+s}) ventilation flow rates (arrows indicate the reference axis).

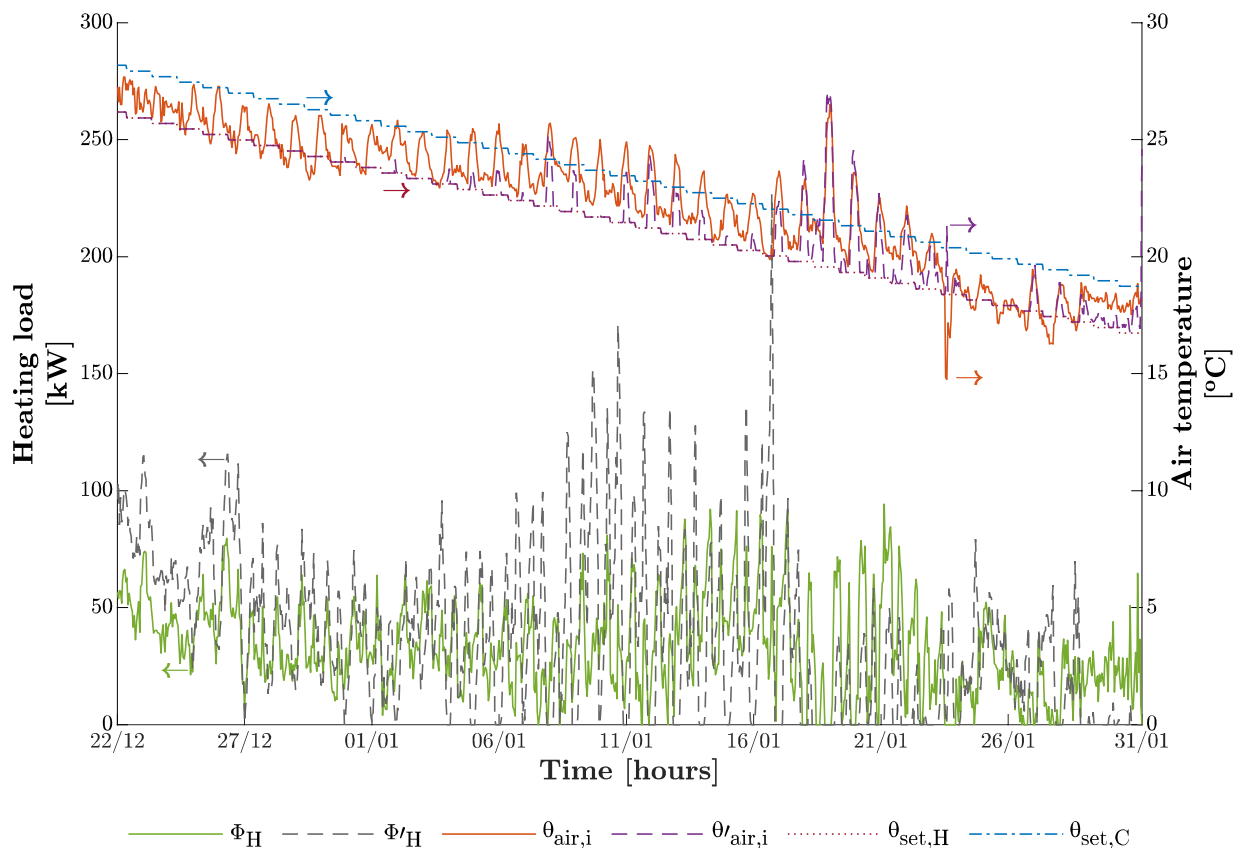


Fig. 6. Trend of indoor air temperature ($\theta_{air,i}$), indoor air temperature considering increased ventilation ($\theta'_{air,i}$), heating ($\theta_{set,H}$) and cooling ($\theta_{set,C}$) set point temperatures. On the secondary axis, heating load (Φ_H) and theoretical heating load (Φ'_H) are shown (arrows indicate the reference axis).

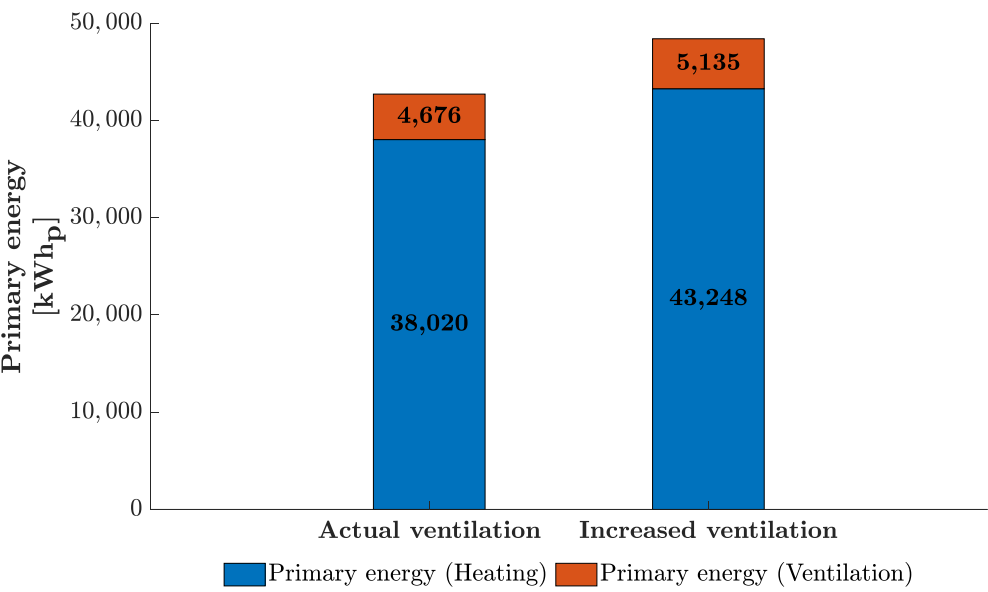


Fig. 7. Comparison between the total primary energy consumption (and the shares due to heating and ventilation) considering the actual and the increased ventilation flow rate.