

The integrated design of building services by an equipped and eco-efficient module (MOTE2)

Original

The integrated design of building services by an equipped and eco-efficient module (MOTE2) / Giordano, Roberto; Allione, Cristina; Clos, Andre'; Montacchini, ELENA PIERA; Tedesco, Silvia. - In: VITRUVIO. - ISSN 2444-9091. - 1:2(2016), pp. 12-23. [10.4995/vitruvio-ijats.2016.6795]

Availability:

This version is available at: 11583/2672105 since: 2021-02-12T16:05:39Z

Publisher:

Universitat Politècnica de València

Published

DOI:10.4995/vitruvio-ijats.2016.6795

Terms of use:

This article is made available under terms and conditions as specified in the corresponding bibliographic description in the repository

Publisher copyright

(Article begins on next page)



ITRUVIO

International Journal of
Architectural Technology and Sustainability

2016





ITRUVIO

International Journal of
Architectural Technology and Sustainability

2016



EDITORIAL TEAM

Editor in Chief

Luis Palmero Iglesias

Universitat Politècnica de València, Spain

Editorial Boarding Members

Pierluigi De Berardinis

Università degli Studi dell'Aquila, Italy

Joaquín Díaz

Technische Hochschule Mittelhessen, Germany

Maria Cristina Forlani

Università degli Studi "G. D'Annunzio" Chieti-Pescara, Italy

Francesco Frontini

Scuola universitaria professionale della Svizzera Italiana, Switzerland

Gilles Perraudin

Architect, Lyon, France

Horst Schroeder

German Association for Building with Earth (DVL), Germany

Advisory Board Members

Avi Friedman

McGill University, Canada

Gerhard Kalhöfer

Gestaltung Hochschule Mainz, Germany

Olimpia Niglio

Kyoto University, Japan

Jesús Marí Farinós

Universitat Politècnica de València, Spain

Managing editor

Stefania De Gregorio

Università degli Studi "G. D'Annunzio" Chieti-Pescara, Italy

LAYOUT/cover design

Serena Motta

Architect and Graphic designer

SUBSCRIPTION INFORMATION

Volume 1, 2 issues: 15€

Contact: pedidos@editorial.upv.es

PRINTED IN SPAIN BY: By print percom, s.l.

EISSN: 2444-9091

On line version <http://polipapers.upv.es/index.php/vitruvio>

Scientific Comitee- Referees

Umberto Berardi

Ryerson University, Canada

Graziella Bernardo

Università degli Studi della Basilicata, Italy

Stefano Bertocci

Università degli Studi di Firenze

Javier Cárcel Carrasco

Universitat Politècnica de València, Spain

Renato Morganti

Università degli Studi dell'Aquila, Italy

Sandro Parrinello

Università di Pavia

Juan Carlos Navarro Fajardo

Universitat Politècnica de València, Spain

Donatella Radogna

Università degli Studi "G. D'Annunzio" Chieti-Pescara, Italy

Adriana Rossi

Seconda Università degli Studi di Napoli, Italy

Francisco Javier Sanchis Sampedro

Universitat Politècnica de València, Spain

English Reviewer

Igor Fernández Plazaola

Universitat Politècnica de València, Spain

Graphic designer

Serena Motta

Architect and Graphic designer

Published by

Univesitat Politècnica de València

CONTACT

Luis Palmero Iglesias

Phone: +34 963879451

Fax: +34 963879129

Email: lpalmero@csa.upv.es



UNIVERSITAT
POLITÈCNICA
DE VALÈNCIA



Organisation
des Nations Unies
pour l'éducation,
la science et la culture



UNESCO Chair
Forum University
and Heritage



forum UNESCO
UNIVERSITY AND HERITAGE

FOCUS AND SCOPE

VITRUVIO Journal is an international research journal publishing articles with links to architectural technology and sustainability. The aim is to present original technical advances as well as innovative methods and applications in order to contribute to the sustainable development through the architecture.

The journal is a resource for sharing innovative researches with an interdisciplinary comparison.

The selection of papers complies with the protocols for scientific publication.

The peer review is done through a system of referees, experts in the field of research.

The journal is published twice a year and appears in digital version.

SECTION POLICIES

Editorial: open indexed

This section describes the point of view of experts in the topics related to the journal. Written by the editorial team or an invited author.

Research articles: submissions, open indexed, double blind peer review

The peer review will evaluate the coherence with the focus and scope of the journal, the technical quality, the technical impact and relevance and the presentation.

OPEN ACCESS POLICY

VITRUVIO Journal provides immediate open access to its content.

ETHIC AND BEST PRACTICES

VITRUVIO, in its commitment to ensure ethical and rigor of its content, follows the Declaration ethic and best practice of PoliPapers (service of the Universitat Politècnica de València to promote open editing of scientific electronic journals).

COPYRIGHT NOTICE

Online journal is published by UPV, being necessary to cite the source in any total or partial reproduction.

Unless otherwise stated, all content of this electronic edition is distributed under a license and distribution "Creative Commons Attribution-Non commercial 4.0" (CC-by-nc).

Publisher allows authors to upload their articles in institutional or subject repositories for their dissemination and preservation.

PRIVACY STATEMENT

The names and email addresses entered in this journal will be used exclusively for the stated purposes of this journal and will not be available for any other purpose or another person.

EDITORIAL QUALITY CRITERIA

Vitruvio journal declares its commitment to respect the integrity of published works. For this reason, plagiarism is strictly prohibited and texts that are identified as either plagiarism or fraudulent content will be removed or unpublished. The journal will act in these cases as quickly as possible. By accepting the terms and agreements expressed by our journal, authors must ensure that the text and the materials associated with it are original (or that they have the publishing permissions) and that there isn't infringed copyright. Authors also have to justify that in case of joint authorship, there was full consensus of all authors involved and that the manuscript has not been previously presented or published in other media.

Expressed opinions are those of the authors and do not necessarily reflect the editorial opinion. All people listed as authors are responsible for the contents of the investigation by having contributed substantially in their physical execution and/or intellectually. Authorship is recognized for the contributions made to the field of knowledge, therefore, the author is responsible for agreeing with the team that took part in the conduct, and for the decision about the order of the authors.

Acknowledgements should be cited, explaining the sources of research funding (if any) and aid, substantial advice or recommendations made by third parties.

COPYRIGHT NOTICE

Hard copy and online journal is published by UPV, being necessary to cite the source in any total or partial reproduction.

Unless otherwise stated, all content of this electronic edition is distributed under a license and distribution "Creative Commons Attribution-Noncommercial 3.0 Spain" (CC-by-nc)




Vitruvio is not responsible for any copyright of the images reproduced in the texts. These are the responsibility of the authors in accordance with the arrangements set out in the call for submissions.

© texts: authors

© images: authors/institutions

TABLE OF CONTENTS

EDITORIAL TEAM	II
CONTACT	II
FOCUS AND SCOPE	III
The natural matter as a new architectural paradigm <i>Gilles Perraudin</i>	VII
Urban microclimate parameters for buildings energy strategies <i>Michele Lepore</i>	1
The integrated design of building services by an equipped and eco- efficient module (MODE ²) <i>Roberto Giordano, Cristina Allione, André Clos, Elena Montacchini, Silvia Tedesco</i>	13
Basalt fibers: the green material of the XXI-century, for a sustainable restoration of historical buildings <i>Giacomo Di Ruocco</i>	25
Redesign a part of the city. From polluting road to sustainable linear square in three "P": profile, permeability, photocatalysis. <i>Alessandro Luigini</i>	41
Design/ Build: A Relevant Pedagogy for Architecture Education <i>Olivier Chamel</i>	53
The need for municipal action planning against flood risk: the risk-informed journey of the municipality of Oliva (Spain) <i>Juan R. Porta-Sancho, Jesica T. Castillo-Rodríguez, Ignacio Escuder-Bueno, Sara Perales-Momparler</i>	67

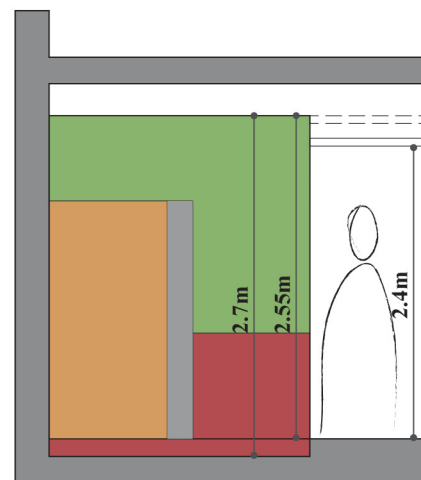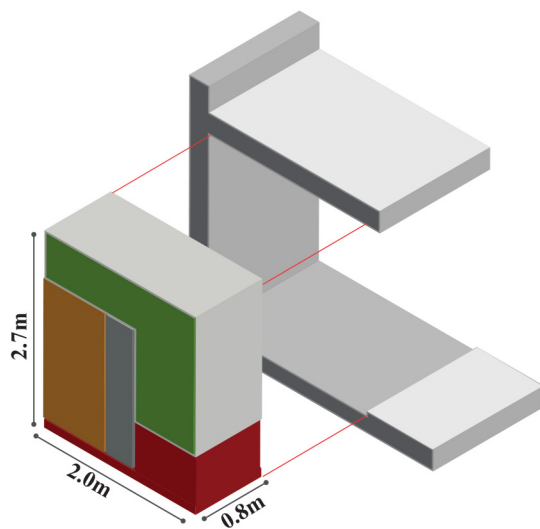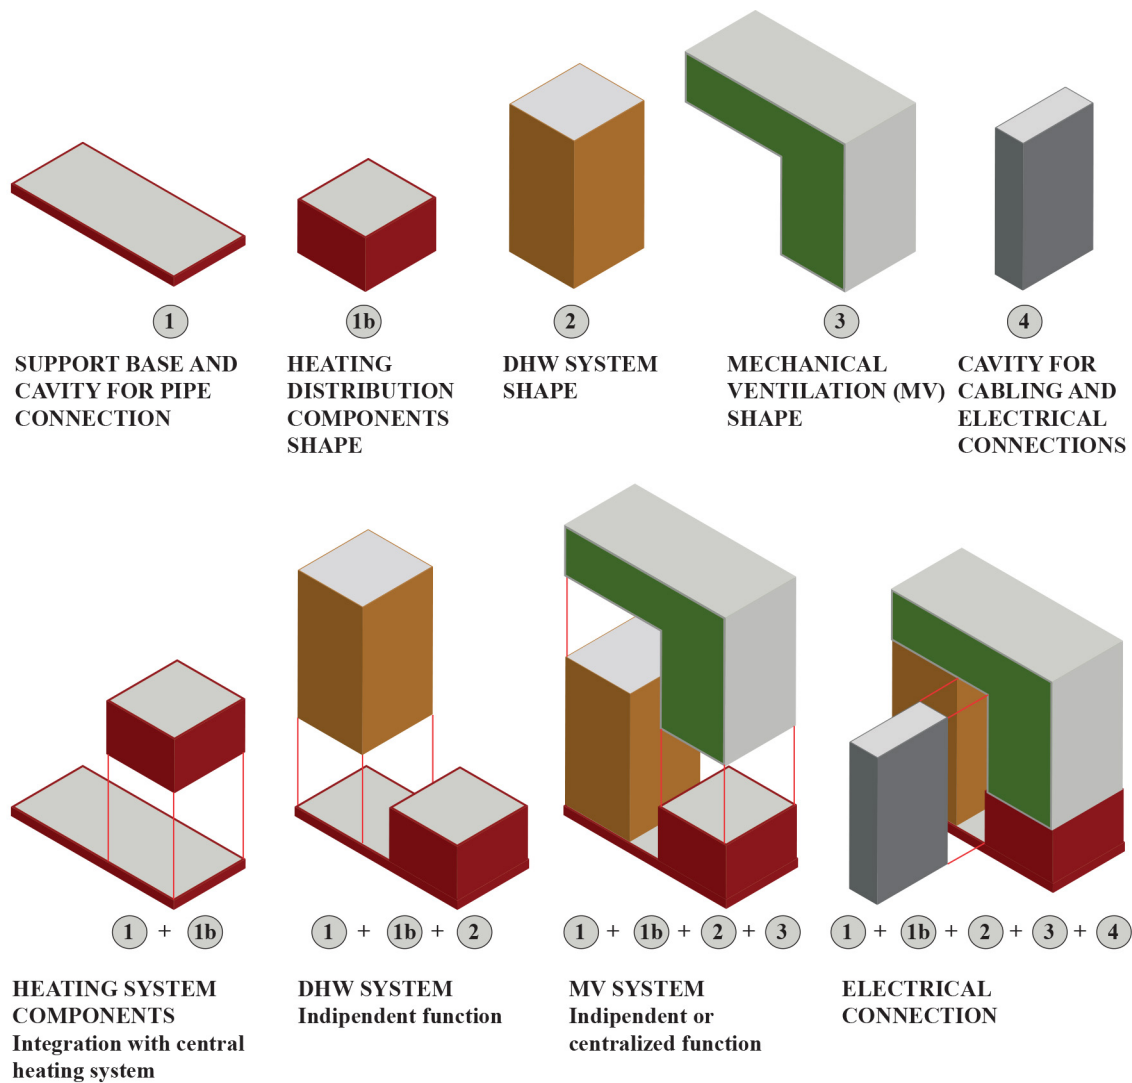

Example of a services cupboard design for the building model "M" Size.
The isometric views show the envelope of the each services and their combination into the cupboard.

The integrated design of building services by an equipped and eco-efficient module (MOTE²)

Roberto Giordano¹, Cristina Allione², André Clos¹, Elena Montacchini¹, Silvia Tedesco¹

¹ Politecnico di Torino, Department of Architecture and Design

² Sarotto Group S.r.l., Ecodesign consultant

ABSTRACT

The targets set out by European Directives concerning the energy savings in the construction sector refer both to building envelope and to its services. With regard to building services it is mandatory meeting requirements related to heating, cooling, lighting and ventilation.

Building services take up a variable space in the buildings that cannot be considered anymore negligible and they would always be fully integrated into buildings.

Equipped and Eco-efficient Technological Module (MOTE²) is a research project aimed at implementing the integration in a unique services cupboard of some building services: heating and cooling; domestic hot water; mechanical ventilation.

The project was organized according to four main phases. In phase 1 a set of rules was defined matching requirements related to the energy efficiency to environmental building design standards. During the phase 2 six building models were studied in order to size the corresponding building services according to scenario analysis set down for existing buildings. In phase 3 the project was focused on designing the assembly among services. The cupboard design is like a Tetris® game through the planning of the best combination among services shape. Based on the drawings developed a first mock-up was built up and monitored. Finally, in phase 4 the paper deals with the MOTE²'s expected performances.

Outlook and some conclusions point out the future steps of the research activities.

KEYWORDS

technological integration of building services, services cupboard for building

1. INTRODUCTION

In recent years a consistent legislative framework aimed at significantly improving the energy efficiency of European buildings stock have been laid down, i.e. the Energy Performance of Buildings Directive (Directive 2010/31/EU), the Energy Efficiency Directive (Directive 2012/27/EU) and the Renewable Energy Directive (Directive 2009/28/EU).

Particularly relevant is the EPBD recast stating that new buildings occupied by public authorities and properties have to be Nearly Zero Energy Buildings (NZEBs) by December 31, 2018 and that new buildings have to be NZEBs by December 31, 2020. According to the EPBD a NZEB is a building that has a very high-energy performance with nearly zero or very low amount of energy required to be covered by energy from renewable sources, including renewable energy produced on-site or nearby.

Based on these premises in the last years several European Countries, including Italy, have been adopting several measures and incentives to get energy savings in the construction sector.

The set out targets refer both to building envelope, by means an improvement of building systems performances in term of thermal insulation, control of air leakages and thermal inertia, and to building services, since it is mandatory meeting requirements related to heating, cooling, lighting and ventilation (Perago et. al., 2009).

Nowadays building services take up a variable space in the buildings - according to their uses - that cannot be considered anymore negligible (e.g. hospitals or some factories require sophisticated installations).

Only in recent times it grows the awareness about the impact of servicing systems and subsystems on the building. Until few years ago the design and installation of services was considered relatively unimportant. The buildings were simpler; featured with boilers and air heating, pipeworks, radiators and convectors as well as with a fume cupboard in the kitchens and in the bathrooms. Nothing more than that. A fragmented approach in planning and construction often took place (Harrison et. al., 2000).

Unpleasantly the lack of a proper integration is

frequently noticeable even in newly constructed buildings.

Systems, pipes and ducts are ungracefully leaned on the buildings roof and on the walls (Figure 1).

On the whole a general building design rethinking is required. Architects, civil engineers and other stakeholders involved in the design and construction processes have to be conscious on the relevancy concerning the building services "accommodation" as well as the importance of their support and enclosure. The paper deals with a reserch project where the building services were sized to providing occupants comfort but - above all - they are designed to be fully integrated into the building.



Figure 1.

Reale Mutua Insurance Headquarter (Turin). Example of lack of integration between building design and its services.

2. THE RESEARCH PROJECT: MOTE²

With the knowledge that services would always be integrated into the structures and systems of the buildings - since the earliest stages of the design process - it was defined the main objective of a research project entitled MOTE² (Equipped and Eco-efficient Technological Module) to integrating in a unique services cupboard (or small storeroom) the main building environmental services. Particularly the research was focused on the following systems: heating and cooling; Domestic Hot Water (DHW); mechanical ventilation.

In the research project other services, such as: lift installations, usually defined as self-contained elements, and sanitary accommodations, usually defined as utility services, were not included.

As mote in English means a small particle or a very tiny part of a substance, the project laid down to use the smallest volume in the apartments with a cupboard where the environmental services are collected in the closest space possible without scarifying safety, maintenance and repairs.

An interdisciplinary team was involved in the research project: the Department of Architecture and Design, DAD (Politecnico di Torino) and a leading enterprise in prefabricated buildings and preassembled systems (Sarotto Group S.r.l.).

The refurbishment of the existing residential building and new semidetached houses are the main reference markets for the Sarotto Group. According to such assumptions the research was focused mainly on developing a services cupboard fit for housings retrofit, new houses with central heating system and new houses with independent heating system for four families¹.

Two Italian climate zones (Figure 2) were considered in the scenario analysis and in the energy assessment: Zone E (degree days average value 2700) and Zone F (degree days average value 3500).

3. METHODOLOGY

The research was organized according to the phases hereafter described:

- phase 1: set out of energy and environmental requirements;
- phase 2: scenario analysis and energy assessment;
- phase 3: design and prototyping;
- phase 4: value proposition definition and performance evaluation.

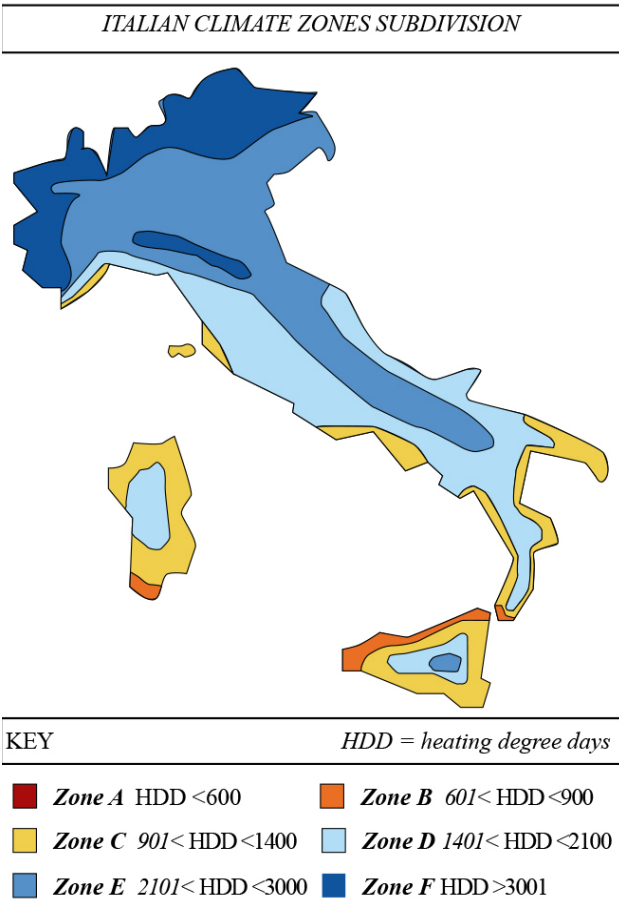


Figure 2.

Italy Climate Zones. Zone E and Zone F were chosen in the building energy analysis.

3.1 SET OUT OF ENERGY AND ENVIRONMENTAL REQUIREMENTS

As mentioned environmental building services normally include installations for meeting indoor comfort requirements with regards to heating, cooling and ventilation.

In phase 1 a set of rules was defined matching mandatory requirements related to the European Directives on energy efficiency to technical standards and specifications governing the environmental building design approach.

Specifically the following environmental standards were analysed and adopted:

- UNI EN 15643-1 and 2: 2010 - Sustainability of construction works;
- UNI 11277:2008 - Sustainability in buildings.

Such standards enable to assess the environmental life cycle of new buildings and the environmental performances of the remaining service life and the end-of-life of existing buildings.

Thus a broader set of requirements was taken into account according to the well-known life cycle design approach.

On the whole four life cycle stages were considered: production stage; construction stage; use and maintenance stages; end-of-life stage.

Seven requirements were associated to production, including mechanical strengths of materials, weight of components and use of green materials. Two requirements were associated to construction, comprising assembling solutions for easy repairs and replacing. Thirteen requirements were associated to use stage, encompassing services maintenance and occupant comfort. Three requirements were finally associated to end-of-life, involving materials and components life-span and recycling.

For each of the twenty-three requirements a related performance assessment (quantitative or qualitative) was provided, according to the standards and technical specifications, or ad-hoc implemented, in coherence with the standards and technical specifications.

As shown in the following paragraphs the requirements

set out was meaningful for the service cupboard design, for sizing the services and for the materials selection.

3.2 SCENARIO ANALYSIS AND ENERGY ASSESSMENT

The scenario analysis carried out refers to a set of theoretical building models with same building features, envelope performances and users behaviour.

Three initial building models reference sizes were assumed in the analysis, with the following condition (useful) floor area: Small Size ($S = 50 \text{ m}^2$), Medium Size ($M = 80 \text{ m}^2$) and Large Size ($L = 120 \text{ m}^2$). Afterwards the reference Sizes were further split in two categories according to the type of heating system. The building models that were studied with a central heating system were classified with the code X.

Thus three building models were classified as: S, M, L (independent heating system) and three building

Building Models	Size		
	$S; X_s$	$M; X_M$	$L; X_L$
Gross Floor area (m^2)	60	95	140
Conditioned floor area (m^2)	50	80	125
Conditioned volume (m^3)	150	240	375
Number of storey above floors (n)	1	1	1
Average floor-to-floor height (m)	3	3	3
Surface area-to-volume ratio (m^{-1})	0.8	0.8	0.8

Table 1.

Theoretical building models features

models were classified as: X_s , X_M , X_L (central heating system). The main reference buildings features are summarised in the table 1.

With regard to the buildings envelope, the models were designed to meet the mandatory energy requirements in force (reference year 2016; UNI TS 11300: 1-2-3-4) for climate zone E and F (Table 2).

Building systems	Zone E	Zone F
Wall systems (with thermal bridge correction)	External insulation layer	External insulation layer
Roof System	Ventilated roof, external insulation layer	Ventilated roof external insulation layer
Windows system	Double glazing with one layer low-E	Double glazing with one layer low-E
Average U-value opaque elements (W/m^2K)	$U_{op}=0,25$	$U_{op}=0,22$
Average U-value glazing elements (W/m^2K)	$U_w=1,7$	$U_w=1,5$

Table 2.

Building envelope performances

Furthermore in the scenario analysis were defined the number of users and their needs in terms of indoor comfort temperature and water consumed by washing and cooking. See table 3.

In the scenario analysis was not considered the Primary Energy Demand (PED) for heating and cooling. Such assumption is directly correlated to the NZEB approach mentioned in the introduction. The NZEB expects an amount of electricity to feed the building produced on-site or nearby by renewable energy sources. In the building models the direct energy was deduced according to a reference framework: climate data;

Building models	S, X_s	M, X_M	L, X_L
Nr° of occupants	2-3	3-4	5-6
DHW supply (l/day)	90	120	190
Occupancy schedule	24/24 hours -7/7 days		
Indoor comfort temperature	$T_{in, H} = 20^\circ C$		
	$T_{in, C} = 26^\circ C$		

Table 3.

Users and associated needs for the building models

building features; user needs. But in such models it was not possible setting down the primary energy conversion factors, since such factors (correlated to the indirect energy value) are strongly dependent on the renewable or fossil sources used; the primary energy it is not an easy predictable based model, its value is influenced by several conditions such as the regional and national electricity energy-mix as well the type of energy sources adopted on site, nearby or far from the building site, e.g. although France and Italy are each other near the electricity is produced with completely different systems. Thus due to the high number of variables to consider for every building Size analysed - were only accounted the direct energy needs.

Finally for the six scenarios no solar or internal gains were taken into account. It was assumed to carrying out an energy analysis through a conservative approach. The heating and cooling loads and the DHW demand were referred to a "design day" when services run at full capacity or fully loaded and the building models are fully occupied by users.

The energy analysis was carried out with regards to the six scenarios developed (Pianese, 2009 and UNI 10339:1995). The following data were performed: thermal energy need for heating and cooling; thermal energy need for DHW; airflow rate (exchange and cooling).

Building Models: M Size; XM Size	Climate Zone	
	E	F
Heating		
Energy need (kWh/m²)	40	56
Max. thermal load (W/m²)	28	33
Cooling		
Energy need (kWh/m²)	16	16
Max. thermal load (W/m²)	45	35
DHW (Domestic Hot Water)		
Energy need (kWh/y)	1270	
Water need (l/day)	120	
Max. DWH flow rate (l/min)	25	
Max. DWH temp. supply (C°)	45	
Air-Flow rate		
Exchange air-flow rate (m³/h)	150	
Cooling air.flow rate (m³/h)	1050	750

Table 4.

Thermal needs and building services sizing parameters. Summary table.

Figure 3.

The building services options analysed and the possible configurations aimed at providing heating, cooling, Domestic Hot Water and ventilation in the building models.

Table 4 displays the energy analysis results concerning two of the building models analysed: M Size and X_M Size.

For the six scenarios the types of buildings services can vary extremely according to energy demands and to exchange airflow rate calculation.

The research projects outlined eight options that can be assumed as best services nowadays available onto the market for the indoor environmental comfort and the domestic water supply (Figure 3) (ASHRAE 2006; D'Alessandris, 2011; Palmieri, 2011).

With regard to figure 3, on the left side are shown the types building services taken into account in the research project. According to the energy analysis carried out, the code S matched with a number (from 1 to 8) shows the suitable configurations planned to provide heating, cooling, DHW and air changes.

For every building model to deducing the number and the type of services to use it is necessary following the dotted line.


For example the S.1 configuration provides a hydronic heating system feed with electricity (H.1); a DHW heat exchanger connected to the thermal storage (D.1); a fan-coil (C.2 and AT.1); an electric ventilation facility (AE.1). While for cooling, air dehumidification and air exchange services the S.1 configuration provides a system (C.2+AT.1+AE.1) that integrates a two-way flow ventilation system (blowers, heat recovery unit and air plenum) and a cooling treatment on the intake air (direct-expansion coils fuelled by refrigerant gas). Furthermore for every analysed service are identified the system features (e.g. H.1 is a service comprising a hydronic heating system, a tank for the storage and an intake manifold).

Furthermore the building service systems are classified both according to the function and to the main fluid used (gas, air or water).

Finally the S.7 and S.8 are the configurations fit for buildings with central heating systems.

Among the eight reference configurations a couple were chosen (see figure 3, the highlighted configurations S.1 and S.7). The selection was based on the requirements set out in phase 1 with regards to use stage. The former - S.1 - is suitable for independent heating systems; the latter - S.7 - (as mentioned) is

SYSTEM FUNCTION FACILITIES SYSTEMS COMPONENTS SETS

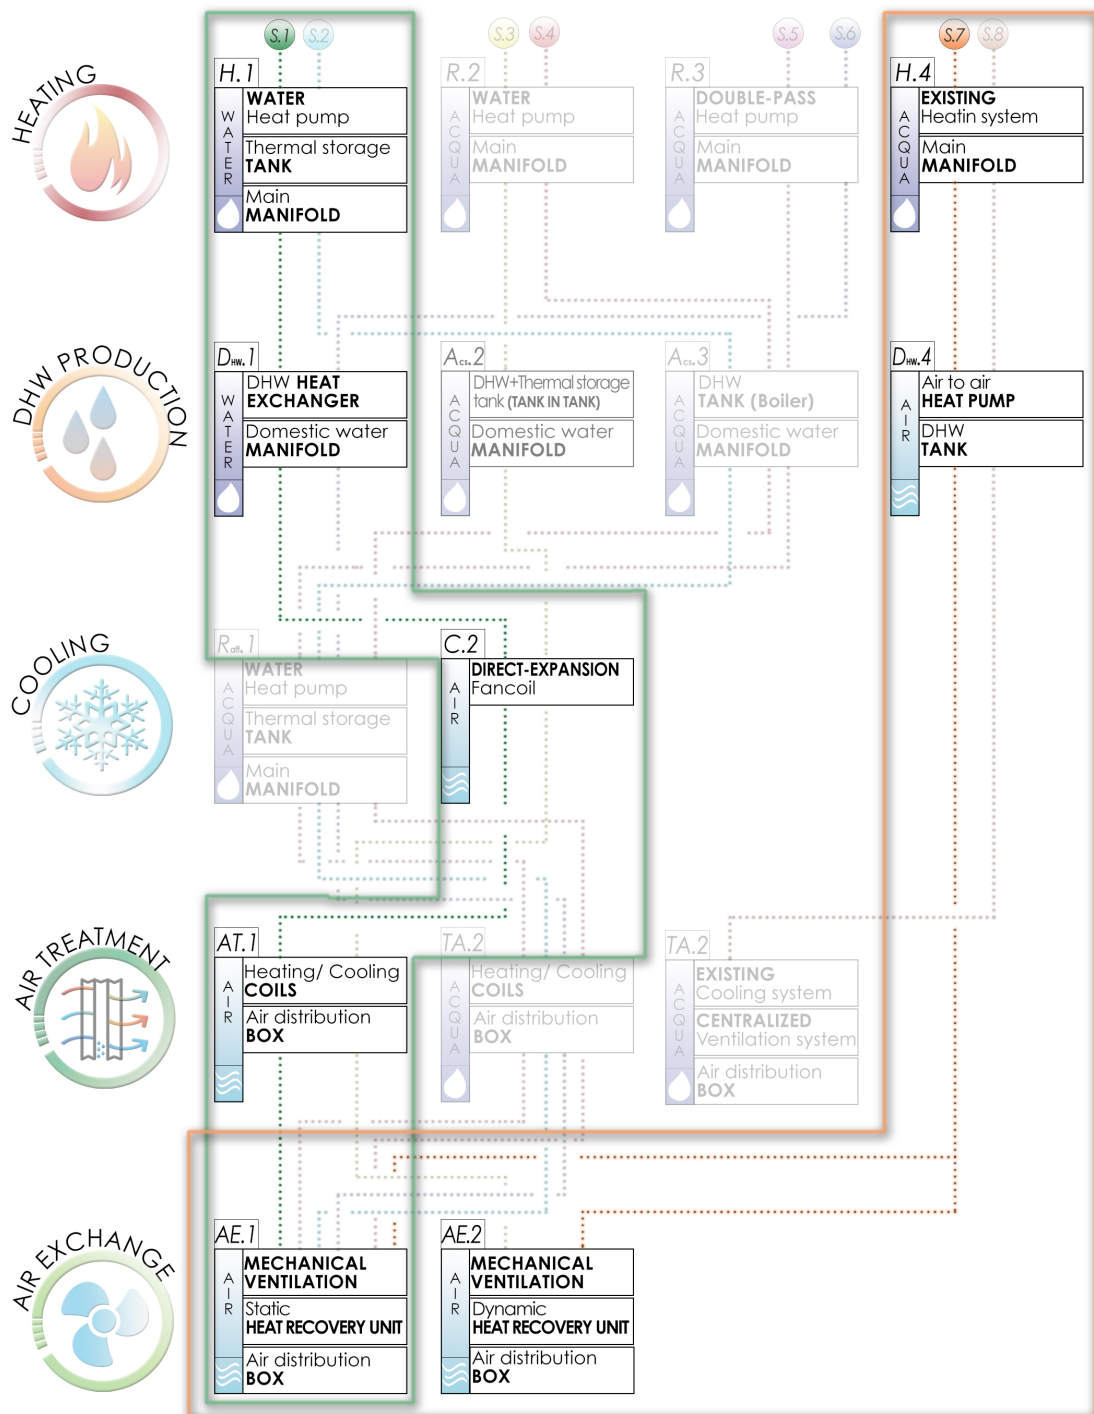

suitable for central heating systems.

Note that in the S.7 configuration the cooling needs are met by the mechanical ventilation system.

3.3 DESIGN AND PROTOTYPING

Following completion the energy assessment for the six building models and the choice of the building services, the research project was focused on designing the assembly of services themselves.

The services cupboard design was basically carried out through a correlation process among the services that were selected and the requirements set out in phase 1.

As a rule the design was influenced by the following performances: durability of services; easy integration of services into the buildings; flexibility for the services to be used in different housing conditions (Attaianese, 2008).

The sizing of the building services and the study of their life stages were key aspects. Particularly the study was focused on the following characteristics:

- services weight (kg);
- services envelope (m³);
- set up procedures (e.g. minimum space in cm around the service to permit their installation in safety and properly conditions);
- maintenance frequency (number and time of repairs and replacements);
- disposal procedures and services waste management.

In this phase a set of real building services was selected and compared to thermal and ventilation needs for each model analysed. Based on average values in terms of length, width and height, the building services were shaped and sketched-out as a simplified envelope. Further to each shaped services was associated a colour.

The cover figure - with reference to S.7 configuration - shows the services needed for the M Size building model. A number identifies a service, while a number and a letter refers to a combination of services. In

particular in figure 3: 1 and 1b were matched to identifying the heating service; 2 was matched to DHW system; 3 was matched to the combination of mechanical ventilation system and cooling service; 4 was matched to space required for hosting the electrical devices. For the M model the cupboard is 2,00 m length; 0,8 m width and 2,40 m height. As shown in figure 4 the cupboard height (less than 2,70 m) makes available an easy technological integration both in the new buildings and in the existing ones.

On the whole the services cupboard design was like a Tetris® game. The cupboard envelope derives by the best combination among all necessary shapes.

An analysis and a selection of materials and components implemented the services cupboard design. Consistently to the design approach adopted for sizing and shaping the building services, the materials and components were sorted - once again - according to the requirements framework defined in phase 1.

The wood based panels were assumed as suitable solution. Such selection is the outcome of a correlation process among performances related to: mechanical resistance; life span; vibration dampen; noise reduction; embodied energy and embodied carbon used for the panelling manufacturing; production costs; distance of potential suppliers. A solid wood panelling was designed for the service cupboard shell (50 mm thickness) and for the partitioning (40 mm). Particularly the partitioning was helpful to define the cavity for store the electrical devices and the wire connections.

Based on the detailed cupboard drawings a first mock-up - named as the research project: MOTE² - was finally built up. To get a quickly technological assessment a couple of workshops were arranged (the number was influenced by research project duration: 18 months). The workshops were aimed at assessing the achievability of the building services design along with the materials selection carried out. During the workshops Sarotto Group laid-down to build the S Size building model with independent heating system. While the mock-up was assembled some little improvements to the previews drawings were necessary. Nevertheless the methodological approach

based on a comprehensive set of requirements to be assessed in the different design and assembling stages has shown its effectiveness and value. On the whole the difference between the design and the mock-up was trivial. In particular the S Size services cupboard dimensions (length, width and height) were comparable to the M cupboard described previously. The mock-up photo is reported in figure 4. On the left - between the shell and the partitioning - were placed the electrical devices. On the top was installed a combined service for mechanical ventilation and cooling. Finally in the central part were positioned the heating service and the DHW system. The mock-up was 10 cm suspended from the floor

in order to facilitate the handling in the construction stage (Figure 5). It was finally planned to monitoring the mock-up in order to check any critical issues that it was not taken into account in the design stage. The monitoring is on going.

3.4 THE PERFORMANCE EVALUATION

The service cupboard - once will be available for the construction market - might be included among the cutting-edge integrated building services. The last phase of the research was focused to point out the MOTE²'s value proposition. MOTE² can be stand out



Figure 4.
The MOTE2 mock up.



Figure 5.
The MOTE2 mock up handling after the service cupboard assembling.

among similar services for the reasons listed below:

- The service cupboard is designed bearing in mind the user needs. The cupboard service is not a ready-made solution imposed. Users chose a customised solution in cooperation with architects and technicians.
- The service cupboard is developed to reduce the on-site installation, since it is designed to be assembled off site and it is easy handling in construction yard.
- The service cupboard envelope is sufficiently strength and resistant to be used both as packaging and shell avoiding extra materials need. Thanks to its features it reduces the amount of waste to dispose.
- The service cupboard is designed to allow an easy access among services and their connections. The space enables an easy access for siting, maintenance and repairs.
- The service cupboard panelling is customizable. The wood based panel can be fixed with different cladding textures.
- The service cupboard provides optimal comfort performances at any time. Each of the configuration developed integrating services for controlling: temperature; relative humidity; air changes per hours. Thus for users indoor pollutions risks are almost completely avoided.
- The service cupboard is both an easy assembling and an easy disassembling technology. A single service can be replaced and dismantled without damaging the other services.
- The service cupboard can be relocated and revised several times. Thus it can be reused in the case of refurbishment or if it is moved to other buildings.

4. CONCLUSIONS AND FUTURE DEVELOPMENTS

The increasing demands of users for improved comfort standards and the energy requirements expected by regulations in force for all kinds of buildings are leading to a change of habits for architects and technicians. The close cooperation is a behaviour that is getting necessary for the sake of the architecture.

The MOTE² research project outcomes prove that an effective integration of building systems and building services is possible. The building 'designed as a whole' in the future probably will be more complicated and sophisticated but still achievable.

Further researches and developments activities on the mock-up require to be undertaken in order to validate the models.

A future research project is under development. Based on the analysis and the monitoring carried out, the achievements will lead to the construction of a prototype. Such prototype will be monitored on a residential building under construction or under refurbishment. The building will have the same features and performances described in paragraph regarding the scenario analysis.

Further comparative studies concerning the materials used for the cupboard shell and partitioning will be drawn up in order to assess other options in addition to those already taken into account.

The monitoring requires to be carried out over a period of 24 months (or more) in order to be able to assess the building thermal performances encompassing a couple of winters and summers. Such periods allows also to test the services durability and plan the their maintenance and replacement.

A proper set of energy and indicators will be also laid down to characterise properly the energy and environmental performances. More climate zones should be considered in the scenario analysis and in the energy assessment.

Finally the project aims to implementing the data available through a Life Cycle Assessment and a Life Cycle Cost, according to NZEB upcoming requirements.

NOTES

1. In compliance with Italian regulations a building with more than four apartments need to be heated with a central heating system.

ACKNOWLEDGMENTS

MOTE² was financed by Piedmont Region through the European Regional Development Fund (ERDF 2007-13). The authors wish to thanks Mauro Sarotto CEO of the Sarotto S.r.l. for his participation in the research project, particularly in the design and prototyping phases. Material sorting was carried out with the help of experts working at the material library MatTo (prof. Claudia De Giorgi and arch. Beatrice Lerma) of the Department of Architecture and Design of Politecnico di Torino. Finally special thanks go to ing. Marco Simonetti for his support in the energy analysis phase.

REFERENCES

- ASHRAE (American Society of Heating, Refrigerating and Air-Conditioning Engineers), Green Guide. The Design, Construction and Operation of Sustainable Buildings II ed., Atlanta (USA), 2006
- Attaianesi E., Progettare la manutenibilità: il contributo dell'ergonomia alla qualità delle attività manutentive in edilizia, Liguori Editore, Napoli, 2008
- D'Alessandris C., Villarini M., Criteri di progettazione degli impianti di climatizzazione, Maggioli Editore, Santarcangelo di Romagna (RN), 2011
- Directive 2010/31/EU of the European Parliament and of the Council of 19 May 2010 on the energy performance of buildings (recast), <http://eur-lex.europa.eu/LexUriServ/LexUriServ.do?uri=OJ:L:2010:153:0013:0035:EN:PDF> (accessed 20.09.2016)
- Directive 2012/27/EU of the European Parliament and of the Council of 25 October 2012 on energy efficiency amending the Directives 2009/125/EC and 2010/30/EU and repealing Directives 2004/8/EC and 2006/32/EC <http://eur-lex.europa.eu/legal-content/EN/TXT/HTML/?uri=CELEX:32012L0027&from=en> (accessed 20.09.2016)
- Directive 2009/28/EU of the European Parliament and of the Council of 23 April 2009 on the promotion of the use of energy from renewable sources and amending and subsequently repealing Directives 2001/77/EC and 2003/30/EC <http://eur-lex.europa.eu/legal-content/EN/TXT/HTML/?uri=CELEX:32009L0028&from=EN> (accessed 20.09.2016)
- Harrison H.W., Trotman P.M., Building Services. Performance, diagnosis, repairs and the avoidance of defects, IHS - BREpress, Garston Watford, United Kingdom, 2000.
- Palmieri C., Armillotta F., Santomauro M., Impianti per edifici a basso consumo energetico, Edicom Edizioni, Milano, 2011
- Perago A., Laforgia D., Ficarella A., Impianti di riscaldamento e condizionamento negli edifici residenziali, Maggioli Editore, Santarcangelo di Romagna (RN), 2009
- Pianese A., Impianti tecnici in edilizia (elettrici di terra e termoidraulici) Dario Flaccovio Editore, Palermo, 2009
- UNI 10339:1995 "Impianti aeraulici ai fini di benessere: generalità, classificazione e requisiti"
- UNI TS 11300:1-2-3-4. Normativa tecnica di riferimento sul risparmio energetico e la certificazione energetica degli edifici, 2008/2012
- UNI 11277:2008 Esigenze e requisiti di ecocompatibilità dei progetti di edifici residenziali e assimilabili, uffici e assimilabili, di nuova edificazione e ristrutturazione
- UNI EN 15643-1 and 2: 2010 - Sustainability of construction works