

An Extended Approach to the Evaluation of Energy Storage Systems: A Case Study of Li-Ion Batteries

*Original*

An Extended Approach to the Evaluation of Energy Storage Systems: A Case Study of Li-Ion Batteries / Cellura, Salvatore; Mazza, Andrea; Bompard, Ettore; Corgnati, Stefano. - In: ELECTRONICS. - ISSN 2079-9292. - ELETTRONICO. - 12:11(2023). [10.3390/electronics12112391]

*Availability:*

This version is available at: 11583/2978898 since: 2023-05-29T09:47:01Z

*Publisher:*

MDPI

*Published*

DOI:10.3390/electronics12112391

*Terms of use:*

This article is made available under terms and conditions as specified in the corresponding bibliographic description in the repository

*Publisher copyright*

(Article begins on next page)

## Article

# An Extended Approach to the Evaluation of Energy Storage Systems: A Case Study of Li-Ion Batteries

Salvatore Cellura, Andrea Mazza , Ettore Bompard  and Stefano Corgnati

Energy Department, Politecnico di Torino, Corso Duca Degli Abruzzi 24, 10129 Torino, Italy; salvatore.cellura@polito.it (S.C.); etторе.bompard@polito.it (E.B.); stefano.corgnati@polito.it (S.C.)

\* Correspondence: andrea.mazza@polito.it

**Abstract:** Energy storage technologies can act as flexibility sources for supporting the energy transition, enabling the decarbonisation of the grid service provision and the active engagement of the customers (both prosumers and consumers), opening for them new business opportunities. Within storage technologies, Lithium-ion (Li-ion) batteries represent an interesting solution for dealing with the majority of these services. In this context, this study addresses an evaluation of economic, environmental and geopolitical risks with reference to the critical raw materials used in the manufacturing of Lithium Iron Phosphate (LFP) Li-ion batteries. The assessment entails grid and prosumer services that these batteries can provide. The exploited economic indicator is the Levelised Cost of Storage, whereas six environmental indicators are used for environmental impact estimation. Cycle stages accounted for in the analysis are the manufacturing and use phases. Finally, the evaluation of the impact of critical raw materials is performed by deploying a Supply Risk indicator, which is instead assessed considering every single material and the overall risk for the battery. High-risk materials are represented by Graphite and Phosphorous. Results denote that, for each service, the number of cycles and the discharge duration are pivotal to make the investment economically and environmentally sustainable. The reduction in the Net Import Reliance, as well as the increase in the Recycling Rate, could sensibly reduce the risk associated with battery raw materials.

**Keywords:** energy storage; li-ion; sustainability; life cycle costing; environmental LCA; critical raw materials



**Citation:** Cellura, S.; Mazza, A.; Bompard, E.; Corgnati, S. An Extended Approach to the Evaluation of Energy Storage Systems: A Case Study of Li-Ion Batteries. *Electronics* **2023**, *12*, 2391. <https://doi.org/10.3390/electronics12112391>

Academic Editors: Oguzhan Ceylan, Murat Gol and Aydogan Ozdemir

Received: 31 March 2023

Revised: 22 May 2023

Accepted: 23 May 2023

Published: 25 May 2023



**Copyright:** © 2023 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

## 1. Introduction

The rapid pace of the increasing anthropogenic greenhouse gas (GHG) emissions pushed governments worldwide to sign the Paris agreement in 2015. The aim of this treaty was to keep the global average temperature increase 2 °C below the pre-industrial level [1]. To reach this target, the European Union (EU) introduced a set of policy initiatives, known as the European Green Deal. Apart from the long-term goal, consisting in reaching net-zero GHG emissions, the EU also established mid-term goals by 2030: a reduction in GHG emissions of at least 40%, an increase in the share of renewable energy in the total energy consumption to at least 32% and an improvement of at least 32.5% in energy efficiency [2]. A new proposal of the European Commission (EC) includes a higher threshold of reduction in GHG emissions, reaching 55% of GHG emissions by 2030. The role of energy in achieving EU climate and energy targets is pivotal, since it is responsible for around 75% of EU GHG emissions [3]. The main strategy for reducing emissions in the energy sector is represented by the shift from fossil fuel generation to a renewable-based one. Particularly, variable renewable energy sources (VRES), represented by solar and wind generators, have negligible emissions during the operational phase and, since that, their capacity is massively growing in the EU [4]. In particular, the average share of electricity from VRES generation, including both wind and solar generation, in the EU electricity mix increased from around 0.16% in 2004 to 20.54% in 2019 [5]. However, VRES also represent an issue

for the electricity system, due to their aleatory and intermittency [6]. These issues can be managed from the system through the exploitation of flexibility sources, such as energy storage and conversion technologies, demand response and VRES curtailment [7]. Within energy storage technologies, Lithium-ion (Li-ion) batteries are characterised by high round-trip efficiency, high energy density and low self-discharge; since that, they emerged as one of the most technically efficient energy storage solutions, both for stationary as well as for mobility applications [8,9]. Their crucial role in the clean energy transition is testified by the launching of the European Battery Alliance (EBA) by the EC in 2017 [10]. The aim of the EBA is to ensure a sustainable battery value chain, considering both the access to raw materials as well as the environmental and economic sustainability of these batteries throughout their whole life cycle. The theme of critical raw materials of batteries was also highlighted from several reports made by the EC [11–13]. An EC platform was released in 2015 for recognising the main stocks and flows in the batteries' value chains [13]. In [11], the EC underlined the dependency of foreign countries on battery raw materials, especially in the first stages of the supply chain. Although it is expected that the EU, through the construction of gigafactories, will reach 69% of its demand of Li-ion batteries in 2025, an upstream raw materials segment still remains an open issue [12]. On the basis of the previous considerations, the supply risk of non-fossil fuel raw materials is gaining much more interest compared to the past. This topic can be outlined in different ways, according to the geographical and temporal boundaries, as well as to the followed approach and the target of the study [14]. In many cases, the risk assessments focus on the economy as the object of the evaluation [15–21]. In others, the study object is instead a specific product [22–27]. Geographical boundaries involved the United Kingdom [15], United States [20,21] and the EU [16–19] economies. Geographical boundaries of product-oriented analyses are, in some cases, on a global scale [22,23]. In most of the cases, product-oriented analyses are made at country or regional level [24–26,28]. When specified, the time-frame of these analyses covers either the short or the medium term, since the long-term analyses are usually more focused on resource depletion [29]. Some works emphasise the word *criticality*, which accounts for probability and vulnerability aspects of raw materials [16–19,26]. Therefore, the criticality concept overlaps with the classic risk definition, as pointed out in [24,30]. Vulnerability aspects, representing the potential damages linked to the supply disruption, are usually tackled considering proxy indicators, such as the Gross Value Added of these materials in industrial sectors [16–19]. Other authors instead take into account the mass of the material with respect to a reference value [24,27]. The methodological framework of these works is aligned with the Life Cycle Sustainability approach, since the presence of Characterisation Factors is linked to raw material deployment at the product level. Another important issue usually tackled in sustainability studies (and not investigated in this paper) is the environmental life cycle analysis of the batteries [31–34]. In [31], a techno-economic and environmental comparison was carried out between combined cycle gas turbines (CCGTs) and battery energy storage systems (BESSs). The results showed that switching from the electricity produced from CCGTs to the electricity discharged from BESSs, fed by high shares of renewable energy, could reduce greenhouse gas emissions by 86%. Other works instead investigated the role of BESSs in frequency-based grid services [32,33]. In detail, a comparative life cycle assessment between coal-based power plants (CPPs) and BESSs was made, showing that BESSs have better environmental performances compared to CPPs, especially when they are used to switch from fossil-fuel-based power plants to renewable-based ones. According to the previous considerations, the aim of this work is two-fold, and it consists of the following:


- Providing an extended methodology applied to Li-ion batteries that includes environmental, economic and supply risk features; the latter ones are investigated for the manufacturing and the use phase of the batteries.
- Exploiting the methodology to assess the variability of these features according to the service provided by Li-ion batteries.

The last domain (i.e., supply risk) was accounted for to enlarge the perspective on sustainability and investigate the possible trade-offs among conflicting domains. The rest of this paper is structured as follows:

- Section 2 presents the metrics deployed for the proposed assessment, as well as the case study.
- Section 3 shows the quantitative estimation of the analysis, sub-divided for each deployed metric; furthermore, a sensitivity analysis and a discussion of the overall results are carried out.
- Section 4 presents the main achievements of this work, the concluding remarks and the possible future applications.

## 2. Materials and Methods

The sustainability assessment of the Storage accounts for the environmental Life Cycle Assessment (eLCA), the Life Cycle Costing (LCC) as well as for the geopolitical risk of materials (GRMs). Within the boundary of the investigated system are included both the manufacturing and the operational phase. The end-of-life is instead outside the system boundaries due to the lack of information related to it. The methodological approach is aligned to LCA methodology, defined by ISO 14040 and ISO 14044 [35]. Figure 1 shows the overall methodological approach. The first step is the Goal and Scope Definition. This consists of clearly defining the Aim of the study, the Functional Unit as well as the Boundaries of the System. The second step is the Inventory Analysis, in which useful data are collected and scaled according to the Functional Unit for the assessment. Then, as the third step, the Impact Assessment aims at quantifying the impact of selected Impact Categories. Finally, the Interpretation is exploited for the critical evaluation of the Impact results from the analyst. Further potential adjustments can be made from the LCA analyst in the previous steps, according to the results obtained (e.g., the expansion of the system boundaries).

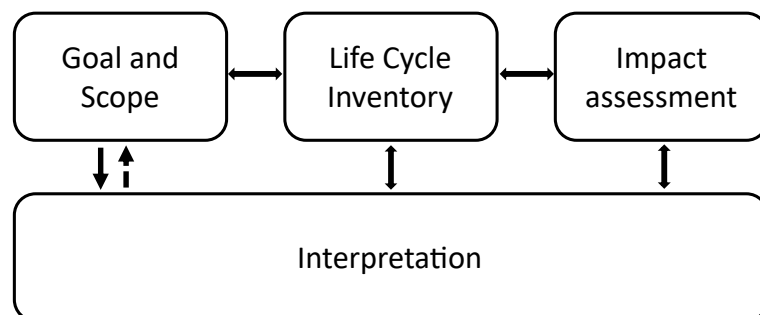

**Figure 1.** Schematic representation of Life Cycle assessment stages according to ISO 14040-14044.

### 2.1. Characterization of the Energy Storage Use: Overview of the Electrical Services

Regarding the services that Energy Storage Systems can provide, they can be split into grid-based, customers-based (i.e., Energy Arbitrage services) and seasonal services. Grid services include all the services required to maintain a proper operation of the power system. Selected services were reported in Table 1. Within grid-based services, a further distinction can be made in Frequency Containment Reserve (FCR), automatic Frequency Replacement Reserve (aFRR), manual Frequency Replacement Reserve (mFRR), Replacement Reserve (RR), Black Start and Congestion Relief and Investment Deferral (CR & ID) [36,37]. In detail, the FCR exploits flexibility sources to limit within certain limits the frequency deviations from the nominal value (50 Hz in Europe). The aFRR acts instead as a further reserve to restore the frequency nominal value and make available again the FCR, while the mFRR is exploited for restoring the FCR and aFRR. In some countries, the RR is deployed as a further restoration tool. Black start represents a further tool in case of electricity system collapse, to energise crucial components (e.g., power plants). CR & ID is a service that enables the proper management of the power congestions and aims to delay grid economic investment (e.g., increasing the power lines' capacity). Energy Arbitrage is instead a service exploited

by prosumers (defined in [38] as the network users that consume and produce electrical energy) for obtaining economic profit by the deployment of renewable generation coupled with Storage Systems [39,40]. Finally, seasonal services are exploited for storing energy for long periods of time (i.e., weeks or months). As can be seen in Table 1, each service is characterised according to three main features, namely the response time, the discharge duration and the yearly cycles. These key features represent the minimum requirements that flexibility tools, such as energy storage systems, must have in order to provide the specific service. In detail, the response time is the maximum time for the energy storage to reach its full power, while the discharge duration is the minimum amount of time in which the flexibility source has to deliver energy for satisfying the service considered [41]. Yearly cycles are instead the expected number of cycles made by the storage system for providing that service. However, due to the great uncertainty concerning these features, in most cases they are provided in a range rather than with specific values.

**Table 1.** Main features of Electricity Services.

| Service     | Response Time | Discharge Duration | Yearly Cycles | Type     |
|-------------|---------------|--------------------|---------------|----------|
| FCR         | 2–3 s         | 0.25 h             | 250–12,000    | Grid     |
| aFRR        | 1–5 s         | 0.25 h             | 250–10,000    | Grid     |
| mFRR        | >5 min        | 0.25 h             | 20–50         | Grid     |
| RR          | >15 min       | 0.25–1 h           | 20–50         | Grid     |
| Black Start | 10 min        | 1 h                | 10–20         | Grid     |
| CR & ID     | min           | 2–8 h              | 360–380       | Grid     |
| Arbitrage   | min           | 1–10 h             | 270–300       | Customer |
| Seasonal    | min           | 5–336 h            | 1–5           | -        |

## 2.2. Domains of the Analysis

### 2.2.1. Economic Domain: Life Cycle Costing (LCC)

The evaluation of the LCC (i.e., the costs incurred by the system throughout its entire life cycle) is performed by exploiting the Levelised Cost of Storage (LCOS), defined as the specific cost for discharging a unit of energy. It can be expressed in mathematical terms as follows:

$$\sum_{t=1}^T \frac{E_t \cdot LCOS}{(1+i)^t} = TLCC \Rightarrow LCOS = \frac{TLCC}{\sum_{t=1}^T \frac{E_t}{(1+i)^t}} \quad (1)$$

In (1),  $E_t$  and  $TLCC$  represent the energy discharge at year  $t$  from the storage and the total Life Cycle Cost, respectively.  $TLCC$  is expressed in EUR, and it accounts for Capital Costs, O&M Costs, as well as for Charging Costs and End-of-Life Costs (i.e., including Decommissioning, Disposal and potential Recycling Costs):

$$TLCC = \sum_{t=0}^T (C_{cap,t} + C_{O\&M,t} + C_{charge,t}) \cdot (1+i)^{-t} + C_{EOL} \cdot (1+i)^{-(T+1)} \quad (2)$$

$C_{cap,t}$ ,  $C_{O\&M,t}$ ,  $C_{charge,t}$  and  $C_{EOL}$  appearing in (2) represent the capital costs, the O&M costs (i.e., the costs associated with operating and maintaining the system, not including replacement costs and charging costs), the Charging Costs and End-of-Life Costs, respectively.  $E_t$  can instead be expressed in the following way:

$$E_t = E_{n,t} \cdot DOD_{max} \cdot \eta_{rt} \cdot \kappa_{cy} \quad (3)$$

where  $E_{n,t}$ ,  $DOD_{max}$ ,  $\eta_{rt}$  and  $\kappa_{cy}$  represent the Energy Capacity of the Energy Storage, the maximum Depth of Discharge, the round-trip efficiency and the number of cycles per year, respectively. Terms appearing in (2) and (3) are properly discounted by the Discounting Factor  $(1+i)^t$ , where the term  $i$  represents the interest rate. The mathematical formulation for the EOL costs is instead slightly different, since they are discounted considering just the year after the end of the useful life of the system  $T+1$ .

### 2.2.2. Environmental Domain: Environmental Life Cycle Assessment (eLCA)

The eLCA involves the evaluation of environmental impacts of the investigated products throughout the whole life cycle or part of it. The exploited approach is the Attributional eLCA, which estimates the environmental burdens belonging to the products [42]. Environmental burdens for each Impact Category are computed as follows:

$$EI_z = \sum_{j=1}^J e_j \cdot CF_{z,j} \quad (4)$$

where  $EI_z$  represents the environmental impacts for the  $z$ th environmental domain,  $e_j$  is the  $j$ th elementary flow and  $CF_{z,j}$  is the characterisation factor the  $z$ th domain and the  $j$ th elementary flow [43]. In detail, elementary flows represent the raw materials and emissions linked to the product under evaluation, and they are normalised according to the functional unit. The functional unit of this work is equal to the lifetime electricity discharged from the storage system. Since the focus of the study is related to the manufacturing and the use phase, the elementary flows can be scaled in the following way:

$$e_j = e_j^{(man)} + e_j^{(use)} \quad (5)$$

As shown in (5), the contribution of the  $j$ th elementary flow has been partitioned in the manufacturing phase ( $e_j^{(man)}$ ) and use phase ( $e_j^{(use)}$ ). Flows linked to the manufacturing phase can be further expressed in the following way:

$$e_j^{(man)} = \frac{E_j^{(man)}}{\sum_{t=1}^T E_t} \quad (6)$$

where  $E_j^{(man)}$  is the  $j$ th absolute elementary flow. The generic elementary flow linked to the use phase  $e_j^{(use)}$  accounts for the delivering of 1 kWh of electricity, considering the round-trip losses:

$$e_j^{(use)} = \frac{e_j^{(el)}}{\eta_{rt}} \quad (7)$$

where  $e_j^{(el)}$  is the  $j$ th elementary flow linked to the charge of electrical energy within the storage system. The selected impact categories are listed in Table 2. All the Indicators are quantified through the equivalent units of a reference substance (e.g., for Climate Change is the Carbon Dioxide).

**Table 2.** Overview of Impact Assessment Categories deployed in this study.

| Impact Category            | Indicator | Unit of Measure                | Brief Description  |
|----------------------------|-----------|--------------------------------|--|
| Climate Change             | GWP100    | kgCO <sub>2,eq</sub>           | Global Warming Potential of Atmospheric emissions of Greenhouse Gases in a 100-year time horizon                       |
| Acidification              | ACD       | molC <sub>H+eq</sub>           | Release of H+ ions caused by air emissions of SO <sub>x</sub> , NO <sub>x</sub> and NH <sub>3</sub>                    |
| Terrestrial eutrophication | TE        | molC <sub>N<sub>eq</sub></sub> | Atmospheric nitrogen compounds deposition (NO <sub>x</sub> , NH <sub>3</sub> )   |
| Freshwater eutrophication  | FE        | molC <sub>P<sub>eq</sub></sub> | Soil and water phosphorous compounds deposition  |
| Marine eutrophication      | ME        | kgN <sub>eq</sub>              | Emissions of nitrogen compounds in marine ecosystems   |
| Resource depletion         | RD        | kgSb <sub>eq</sub>             | Exploitation of natural resources for the life cycle of the product, compared to the "Reserve Base" of these resources |

### 2.2.3. Geopolitical Domain: Geopolitical Risk of Materials (GRMs)

Concerning the GRMs, the materials included in the analysis are the following ones:

- Lithium Iron Phosphate Oxide ( $LiFePO_4$ );

- Natural Graphite;
- Copper;
- Aluminium.

Particularly, Lithium, Iron and Phosphorus are considered the embedded elements under investigation for  $LiFePO_4$ . The choice of these battery materials is due to the mass share of these components. In fact, they represent around 45% of the mass of the Battery Pack. Life Cycle stages included within the risk analysis are the extraction and the processing. The choice is related to the fact that bottlenecks (i.e., high concentrations of materials) are usually concentrated on the first stages of manufacturing. The evaluation entails in particular the element embedded within the battery materials and in the upstream supply chain stages. In fact, material flows are computed relying on the mass conservation law and neglecting further conversion losses [44]. The characterisation factors, exploited for the evaluation of the supply risk of the battery materials, are taken from the criticality assessment of the EC for EU-27 [18]. This approach takes into account the supply risk and the economic importance as the two main parameters for the evaluation of the criticality of the materials for the EU-27 economy. Since economic importance is referred to in all the economic sectors, and this analysis is referred to as a specific product, this parameter has been not included in the evaluation [14]. The supply risk  $SR_m$  for the  $m$ th material is instead exploited as the proxy indicator for the estimation of the risk of the materials and it can be expressed as follows:

$$SR_m = f(HHI, WGI, SI, EoLRIR, NIR) \quad (8)$$

In (8),  $HHI$  represents the concentration index of the supplier countries,  $WGI$  is the arithmetic average of the six worldwide governance indicators developed by the World Bank [45] (intended to indicate the geopolitical stability of the supplier countries),  $SI$  is the substitution index of the material (measuring the physical availability of possible substitute materials, with respect to the assessed ones),  $EoLRIR$  is the recycling rate at the end-of-life (i.e., the share of dismantled materials that can be reused instead of virgin materials in a manufacturing process) and  $NIR$  is the ratio of the net import and the apparent consumption. In particular, the  $NIR$  can be expressed in the following way:

$$NIR = \frac{w_{Imp} - w_{Exp}}{w_{Prod} + w_{Imp} - w_{Exp}} \quad (9)$$

In (9), the terms  $w_{Imp}$ ,  $w_{Exp}$  and  $w_{Prod}$  represent the material quantities imported, exported and internally produced (i.e., the domestic production), respectively. It can be seen how the denominator terms can be grouped in an aggregated indicator, called apparent consumption.

A further step to be carried out is the aggregation in  $SR_b^{(ec)}$  (i.e., the supply risk normalised with respect to the battery energy capacity) of the supply risk indicator values (i.e.,  $SR_m$ ) taken from the literature, which is achieved by considering the mass share of the materials included in the battery:

$$SR_b^{(ec)} = \sum_{m=1}^M SR_m \cdot \omega_m \quad (10)$$

where  $\omega_m$  is the specific weight of the material, expressed in kg per kWh of energy capacity. Therefore, the supply risk of single materials are deployed as characterisation factors (CFs). The latter ones represent the relative contribution of each materials to the geopolitical risk impact category. The normalised risk  $SR_b$ , scaled according to the functional unit (i.e., the lifetime electricity delivered by the Li-ion batteries), is instead equal to:

$$SR_b = SR_b^{(ec)} \cdot \frac{E_{n,t}}{\sum_{t=1}^T E_t} \quad (11)$$

In (11),  $SR_b$  is expressed in kg per kWh of energy delivered by the storage system throughout its useful life.

2.3. Case Study

2.3.1. Features of the Batteries under Investigation

The systems under study refer to three different Lithium-ion battery plants. The core of the three systems is the Battery Pack is graphically reported in Figure 2. The battery is composed of the module (i.e., the set of battery cells that are connected in series and parallel), the Battery Management System (BMS) and the Cooling System [46]. The module is composed of battery cells, each of them having a cathode, anode, an electrolyte and a separator. Finally, the cathode and anode are characterised by the active part of the electrode and the collectors (apart for small quantities of binders and carbon black to improve conductivity). The latter ones are usually represented by Copper and Aluminium for Li-ion batteries. Since the focus is on the LFP type, a cathode is composed of the Lithium Iron Phosphate as the active material, whereas the anode is made of Graphite.

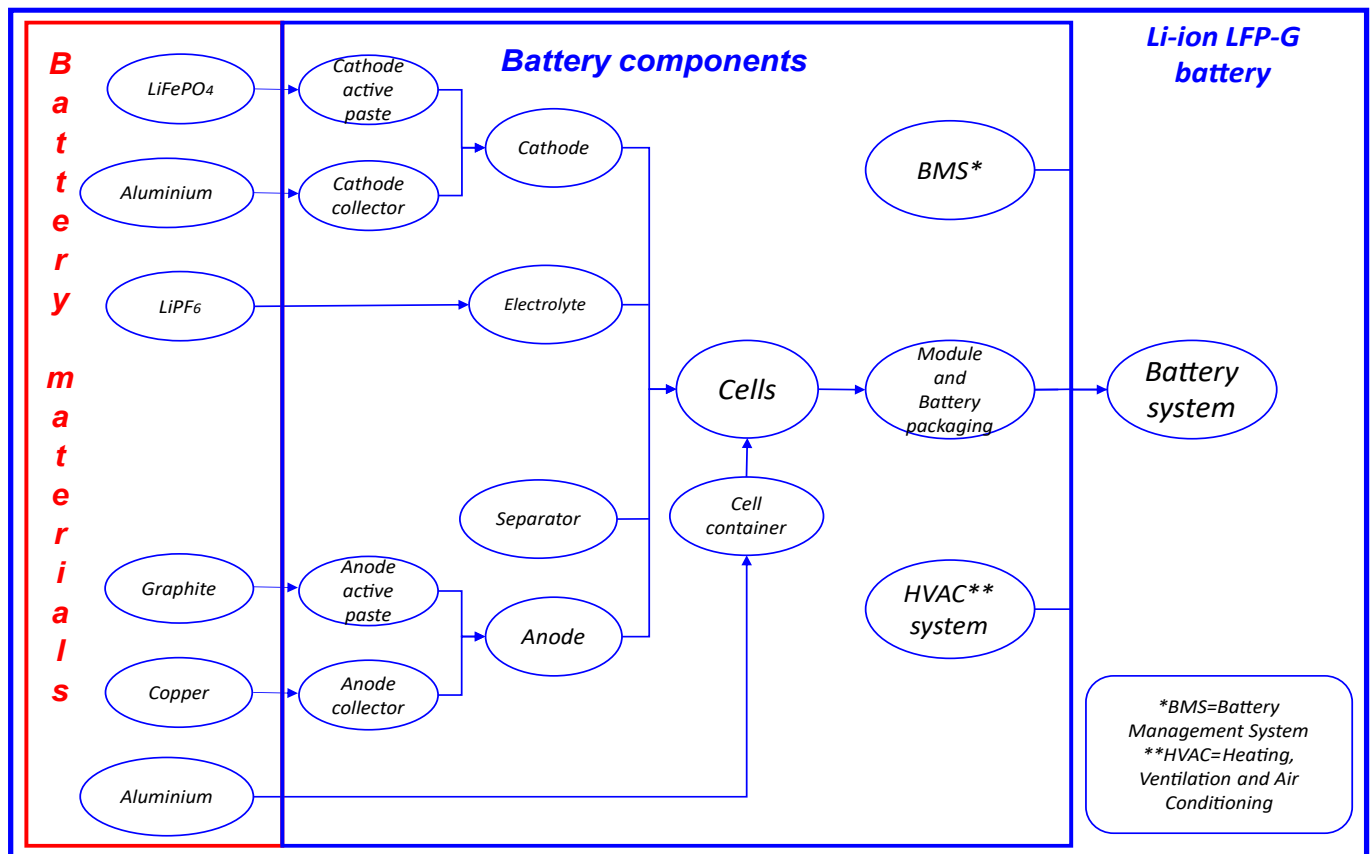


Figure 2. Schematic representation of a LFP battery pack.

Battery plants are specifically declined according to the electricity service provided. Particularly, for the grid services requiring high power, Utility-scale Li-ion batteries can be deployed. For the Arbitrage, it is instead possible to identify commercial/industrial prosumers and residential ones. The main difference between the the batteries deployed in these applications is the size, with Residential Li-ion Batteries in the order of a few  $kW_{DC}$ . The different nominal powers of the three Li-ion battery systems investigated in this work are listed in Table 3. Moreover, the cell voltage is equal to 3.3 V [47]. From the analysis of the state-of-the-art, no detailed data have been found about the battery cell layout, due to the fact that these technologies are generally patented.

**Table 3.** Main features of different typology of Lithium-ion-based battery plants.

| Typology              | Size (kW)        |
|-----------------------|------------------|
| Utility-scale         | $60 \times 10^3$ |
| Commercial/industrial | 300              |
| Residential           | 6                |

The main technical features of the LFP batteries collected from the literature are reported in Table 4 [34,46,48]. The maximum depth of discharge  $DOD_{max}$  represents the maximum discharge that the battery can sustain without meeting premature ageing [49,50]. The cycle life expectancy at <70%, named  $\kappa_c$ , is instead the foreseen number of cycle of the battery before it reaches 70% of its original capacity, considering working conditions that do not exceed  $DOD_{max}$  [51]. According to the literature data, cycle life expectancy for LFP batteries is variable in the range of 2500–10,000 [34,46–48,52,53]. Main uncertainties depend on the manufacturer, the operating temperatures, the charge/discharge duration and the depth of discharge [53]. An average value of 5000 cycles is selected, according to [47]. However, in case of really fast discharging (e.g., for frequency regulation services) the cycle life of these battery cells can sensibly decrease [53]. In order to tackle this issue, a sensitivity analysis is carried out, and presented in Section 3.4. The assumed battery charge and discharge efficiencies, denoted as  $\eta_{DC}^{(ch)}$  and  $\eta_{DC}^{(dch)}$ , respectively, account for energy losses throughout the electro-chemical conversion. Furthermore, inverter efficiency  $\eta_{inv}$  accounts for conversion losses from DC to AC and vice versa. Finally, round-trip efficiency  $\eta_{rt}$  is obtained through the following formula:

$$\eta_{rt} = \eta_{inv} \cdot \eta_{DC}^{(ch)} \cdot \eta_{DC}^{(dch)} \cdot \eta_{inv} \quad (12)$$

Formula (12) neglects the self-discharge losses in the battery.

**Table 4.** Main features of LFP battery.

| Parameter                        | Symbol              | Value |
|----------------------------------|---------------------|-------|
| Max depth of discharge (%)       | $DOD_{max}$         | 80%   |
| Cycle life expectancy at <70%    | $\kappa_c$          | 5000  |
| Battery charge efficiency (%)    | $\eta_{DC}^{(ch)}$  | 98%   |
| Battery discharge efficiency (%) | $\eta_{DC}^{(dch)}$ | 98%   |
| Inverter efficiency (%)          | $\eta_{inv}$        | 95%   |
| Round-trip efficiency (%)        | $\eta_{RT}$         | 87%   |

### 2.3.2. Scenarios

The assessment of the impacts on the three considered domains (i.e., economic, environmental and geo-political risks with reference to critical raw materials) of LFP battery plants has been carried out by considering five different scenarios characterised by different values of (i) yearly cycles and (ii) discharge duration, according to the different services provided by the batteries. These values are reported in Table 5. In particular, while Scenario A and Scenario E take into account the extreme values of yearly cycles and discharge duration (as found in the specialised literature, such as [36,54,55]), Scenarios B to D aim to consider the variability of these parameters through a sensitivity analysis.

**Table 5.** Main features of LFP battery plant exploitation, for each service and scenario.

| Service               | Parameter              | Scenario A | Scenario B | Scenario C | Scenario D | Scenario E |
|-----------------------|------------------------|------------|------------|------------|------------|------------|
| FCR                   | Yearly cycles          | 250        | 3188       | 6125       | 9063       | 12,000     |
|                       | Discharge duration (h) |            |            | 0.25       |            |            |
| aFRR                  | Yearly cycles          | 250        | 2688       | 5125       | 7563       | 10,000     |
|                       | Discharge duration (h) |            |            | 0.25       |            |            |
| mFRR                  | Yearly cycles          | 20         | 28         | 35         | 43         | 50         |
|                       | Discharge duration (h) |            |            | 0.25       |            |            |
| RR                    | Yearly cycles          | 20         | 28         | 35         | 43         | 50         |
|                       | Discharge duration (h) | 0.25       | 0.44       | 0.63       | 0.81       | 1          |
| Black start           | Yearly cycles          | 10         | 13         | 15         | 18         | 20         |
|                       | Discharge duration (h) |            |            | 1          |            |            |
| CR & ID               | Yearly cycles          | 360        | 365        | 370        | 375        | 380        |
|                       | Discharge duration (h) | 2          | 3.50       | 5          | 6.50       | 8          |
| Arbitrage-Residential | Yearly cycles          | 270        | 278        | 285        | 293        | 300        |
|                       | Discharge duration (h) | 1          | 3.25       | 5.50       | 7.75       | 10         |
| Arbitrage-Commercial  | Yearly cycles          | 270        | 278        | 285        | 293        | 300        |
|                       | Discharge duration (h) | 1          | 3.25       | 5.50       | 7.75       | 10         |

### 2.3.3. Economic Data

Economic input data for the evaluation of the LCC are shown in Table 6. As can be noted, the cost items are differentiated according to the plant typology (i.e., utility, commercial/industrial and residential). These data have been collected from multiple sources and adjusted to take into account the inflation, the conversion rate between USD and EUR and the different labour rates between the United States and European Union [56,57].

**Table 6.** Input data for LCC evaluation.

| Typology    | Battery (EUR/kWh) | Balance of System (EUR/kW) | Installation Costs (EUR/kWh) | Fixed O&M (EUR/kW-yr) | Variable O&M (EUR/MWh) |
|-------------|-------------------|----------------------------|------------------------------|-----------------------|------------------------|
| Utility     | 180               | 239                        | 98                           | 10                    | 0.5                    |
| Commercial  | 191               | 322                        | 439                          | 10                    | 0.5                    |
| Residential | 237               | 747                        | 751                          | 10                    | 0.5                    |

The capital cost items reported are the battery cost, the balance of system (BOS) and the installing costs, whereas replacement costs are supposed to be equal to the share of the capital cost of the battery itself. In detail, battery costs include the capital cost incurred for purchasing the battery (i.e., battery modules, rackets and the battery management system). BOS costs instead entail the structural and electrical components, such as the inverters, cables and the energy management system (EMS). Finally, installing costs are the costs incurred for the construction of the battery plant. O&M costs account instead for fixed operational expenses (Fixed O&M) and variable ones (Variable O&M). Further details are presented in Table 7.


**Table 7.** Cost items deployed in the economic evaluation.

| Item              | Symbol     | Brief Description   | Sub-Items  |
|-------------------|------------|---|--|
| Battery           | $c_e$      | Purchase of the batteries   | Modules, racks, BMS  |
| Balance of system | $c_p$      | Purchase of the BOS   | Inverters, cables, EMS, switchgear, monitor controls, wiring, conduit, foundation, battery containers and inverter house |
| Installing costs  | $c_{inst}$ | Installation of the battery plant                                 | Installation labour and equipment, other soft costs  |
| Replacement costs | $c_{rep}$  | Replacement of the batteries, after they reached their cycle life | Same as battery sub-items  |
| Fixed O&M         | $c_f$      | Fixed operating expenses  | Planned Maintenance, labor   |
| Variable O&M      | $c_v$      | Variable operating expenses                                       | Other non-fuel operating expenses  |

As shown in Table 6, capital costs decrease with the size, whereas the fixed and variable O&M are assumed to be equal for all the three plant typologies. Another LCC input is the useful life of the battery plants, which was assumed equal to 10 years [57]. As discount rate  $i$ , the Weighted Average Capital Cost (WACC) is deployed. WACC for commercially proven and mature technologies is equal to 4% [58]. However, a conservative value of 5% was assumed, aligned with other studies [59]. End-of-Life costs are neglected since the lack of data. Regarding the assessment of the environmental impacts, data in the literature are exploited as the input specifically for the battery pack manufacturing phase [47]. The input electricity for the storage has been hypothesised equal to the EU-27 average mix. Finally, geopolitical risk input data have been collected from several sources, including geological survey institutes [46,47,60–63]. Additionally, materials quantities are collected from [46,47].

### 3. Results and Discussion

This section shows the numerical results of the work, by considering the environmental, economic and supply risk domains (presented in Section 2.2), as graphically reported in Figure 3. The environmental domain is further broken down into several impact categories, whereas the economic and supply risk contain only one specific impact category.

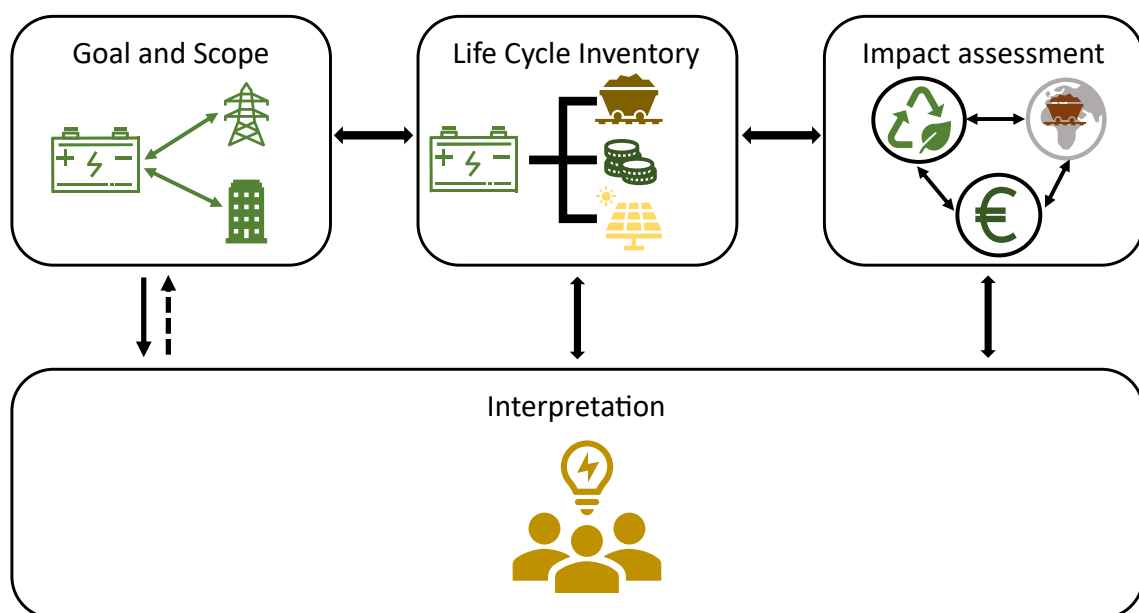

**Figure 3.** Flow chart of the multi-domain assessment.

### 3.1. Economic Domain: LCC Results

The results for the LCC parameter are reported in Table 8. The economic evaluation for each service is measured deploying the LCOS indicator and, therefore, the results are expressed in €/MWh. As described in Section 2.3.2, the assessment takes into account five scenarios of exploitation for each service, namely Scenario A, Scenario B, Scenario C, Scenario D and Scenario E. Frequency-related services with high numbers of yearly cycles are characterised by a lower LCOS, compared to the other services. In detail, the FCR and aFRR have ranges of LCOS equal to 98.1–1206.8 €/MWh and 106.9–1206.8 €/MWh. Grid services with lower numbers of cycles are instead characterised by a LCOS higher than  $2.3 \times 10^3$  €/MWh. In detail, LCOS ranges of mFRR, RR and Black Start are, respectively, equal to  $5.8 \times 10^3$ – $1.4 \times 10^4$  €/MWh,  $2.3 \times 10^3$ – $1.4 \times 10^4$  €/MWh and  $5.6 \times 10^3$ – $1.1 \times 10^4$  €/MWh. These high values are due to the low number of Yearly Cycles (10–50) and the low discharge duration 0.25–1 h, lowering the energy discharged during the operational phase. Finally, CR & ID, Arbitrage-Commercial and Arbitrage-Residential have a LCOS in the range of 210.3–1307.8 €/MWh. Additionally in this case, the higher number of Yearly Cycles determines the lower LCOS, as shown by comparing CR & ID and Arbitrage. A further difference between Arbitrage at commercial/industrial scales and the residential one is due to higher Capital Installing and Replacement Costs for the residential case (see Table 6).

**Table 8.** LCOS (in EUR/MWh) for every service and scenario.

| Service               | Scenario A | Scenario B | Scenario C | Scenario D | Scenario E |
|-----------------------|------------|------------|------------|------------|------------|
| FCR                   | 1206.8     | 177.9      | 140.3      | 112.4      | 98.1       |
| aFRR                  | 1206.8     | 200.9      | 157.1      | 123.9      | 106.9      |
| mFRR                  | 14,461.9   | 10,532.5   | 8287.2     | 6834.3     | 5817.3     |
| RR                    | 14,461.9   | 6851.0     | 4237.5     | 2986.2     | 2273.8     |
| Black start           | 11,152.1   | 8932.5     | 7452.8     | 6395.9     | 5603.2     |
| CR & ID               | 280.5      | 242.7      | 226.5      | 216.9      | 210.3      |
| Arbitrage-Commercial  | 766.1      | 560.9      | 514.6      | 489.4      | 471.3      |
| Arbitrage-Residential | 1307.8     | 889.8      | 799.9      | 753.0      | 720.6      |

Moreover, it was investigated that the share of the main economic voices comprised the LCOS indicator, including the initial investment cost (accounted as overnight cost), the replacement cost, the operation and maintenance cost and the charging cost. These results are graphically reported in Figure 4. A frequency-based service characterised by a high number of cycles (i.e., FCR and aFRR), are the only ones for which it is needed to replace the LFP battery stacks throughout the useful life. Indeed, in Scenario B of these two services, the replacement is carried out every two years, whereas for Scenario C, D and E the replacement occurs every year. Despite the high frequency of replacement, the LCOS sensibly decreases with the increase in the number of cycles. In fact, the reduction in LCOS, going from Scenario A to Scenario E, is equal to 92% for FCR and 91% for aFRR. The reasons to have a higher number of cycles and to more frequently replace the battery stack is the reduced value of future discounted cash flows and the fact that only the stack is replaced, whereas the BOS is not affected by the replacement itself. For grid services characterised by a lower number of cycles (i.e., mFRR, RR and Black Start) the charging cost impact on the overall LCOS is almost negligible, with the share varying in the range of 0.4–2.4%. For such services, major contributors are the initial investment costs (79.2–86.6%) and the O&M costs (12.7–19.9%). Since there are no replacements, their contribution is null. Moreover, CR and ID, Energy Arbitrage Commercial and Residential also have a predominant contribution of the initial investment cost (72–91.5%), while the share of the O&M cost does not exceed 7.3% (specifically going from 0.7% to 7.3%). Due to the relatively higher number of cycles for these services compared to mFRR, RR and Black Start (270–380 vs. 10–50), charging cost are instead higher. Particularly, the share of charging cost goes from 4.1% to 25.5%.

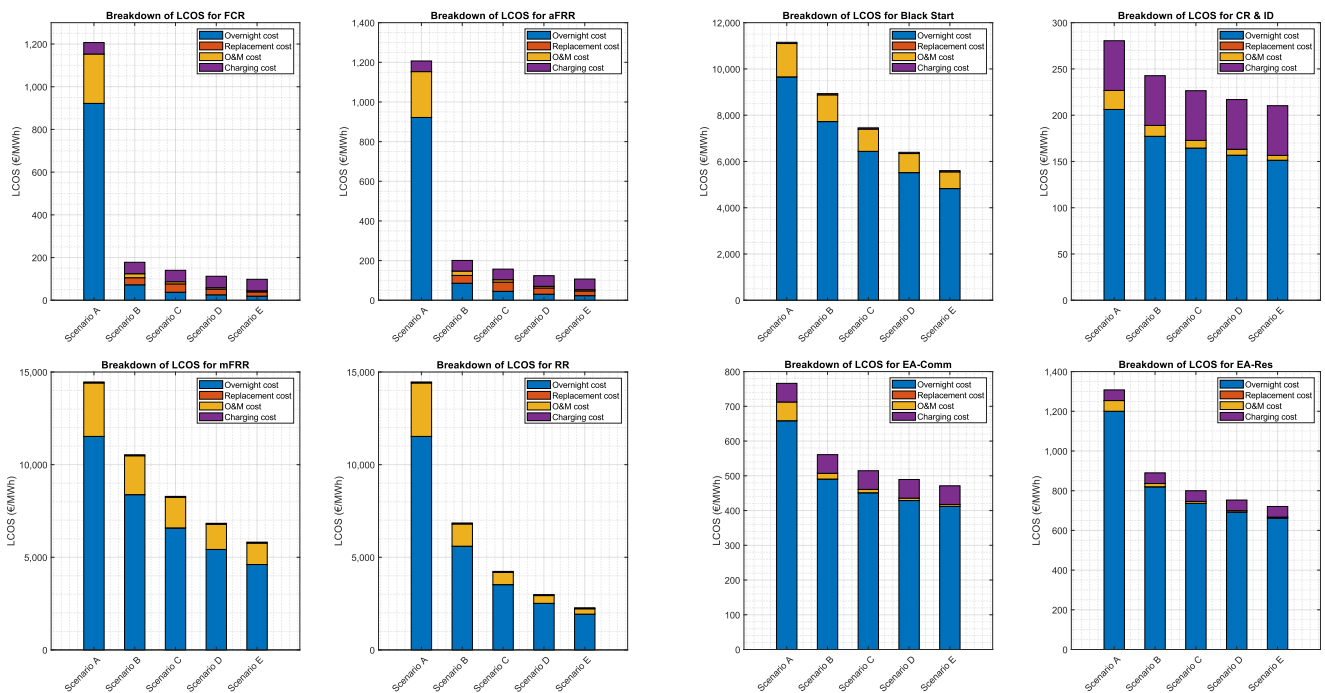


Figure 4. Breakdown of LCOS, for each service and scenario.

### 3.2. Environmental Domain: eLCA Results

The overall environmental impacts, including both the manufacturing and use phase, are graphically reported in Figure 5. The results are expressed per kWh of electricity delivered from the LFP battery. The GWP varies between  $0.47 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$  and  $0.52 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$  for FCR and aFRR. Results are analogous for aFRR, with the only difference represented by the lower boundary ( $0.473 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$ , due to a lower number of yearly cycles ( $1 \times 10^4$  compared to  $1.2 \times 10^4$ ). mFRR, RR and Black Start are instead characterised by higher values of GWP, due to the low number of yearly cycles, equal to 20–50 cycles/year for mFRR and RR, and 10–20 for Black Start. The overall GWP for mFRR, RR and Black Start varies, respectively, in the ranges of  $0.79\text{--}1.28 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$ ,  $0.79\text{--}1.28 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$  and  $1.28\text{--}2.10 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$ . The same scores for mFRR and RR are related to the fact that the ratio between the energy capacity and the energy discharged is proportional to the number of cycles, and not to the discharge duration. CR and ID, Commercial and Residential Arbitrage are instead characterised by low variability due to a small variation in cycles per year. Values for GWP are around  $0.5 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$  for CR & ID, and  $0.51 \text{ kgCO}_{2,\text{eq}}/\text{kWh}$  for the Arbitrage case. In addition, the other environmental impact categories show similar trends, with services with high numbers of cycle and discharge durations characterised by lower impacts. In detail, Acidification values lies in the range of  $2.4 \times 10^{-3}\text{--}2.8 \times 10^{-3} \text{ molc}_{\text{H}^+,\text{eq}}/\text{kWh}$  for FCR and aFRR,  $5.1 \times 10^{-3}\text{--}1.6 \times 10^{-2} \text{ molc}_{\text{H}^+,\text{eq}}/\text{kWh}$  for mFRR, RR and Black Start. Finally, for CR & ID, as well as for Energy Arbitrage, the lower and upper boundaries are between  $2.6 \times 10^{-3}$  and  $2.8 \times 10^{-3} \text{ molc}_{\text{H}^+,\text{eq}}/\text{kWh}$ . The Lower and upper boundaries for terrestrial eutrophication, freshwater eutrophication and marine eutrophication lie, respectively, in the ranges of  $3.5 \times 10^{-3}\text{--}2.1 \times 10^{-2} \text{ molc}_{\text{N}_{\text{eq}}}/\text{kWh}$ ,  $0.5 \times 10^{-3}\text{--}2.6 \times 10^{-3} \text{ kgP}_{\text{eq}}/\text{kWh}$  and  $0.4 \times 10^{-3}\text{--}3.1 \times 10^{-3} \text{ kgN}_{\text{eq}}/\text{kWh}$ . Finally, Resource Depletion impacts vary between  $1.3 \times 10^{-5}$  and  $1.2 \times 10^{-3} \text{ kgSb}_{\text{eq}}/\text{kWh}$ .

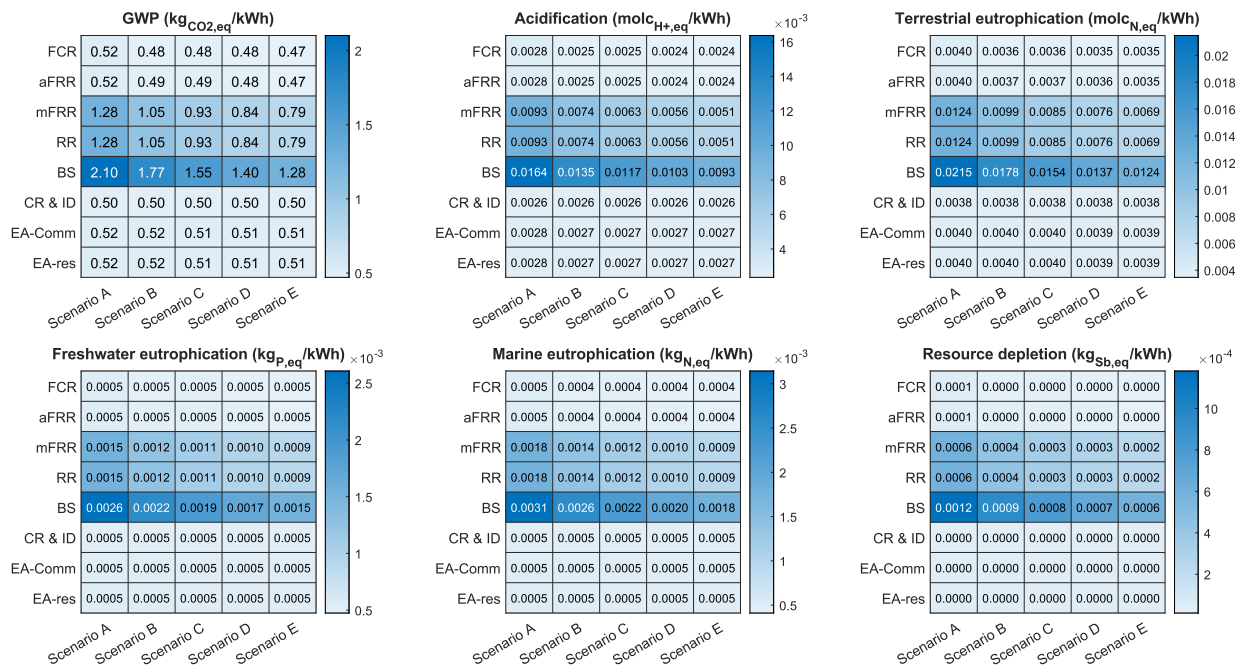


Figure 5. Environmental impacts of Li-ion battery pack for each service and scenario.

Figure 6 reports instead the share of manufacturing and use in environmental impact scores for a selected scenario (Scenario C). Error bars denote the variability with respect to the other scenarios. The share of the use phase for the GWP impact category compared to the overall score is quite high, varying within the range from 87% to 97% for the FCR. The upper threshold of the share of use for the GWP is slightly less for the aFRR, with a value of 96%. The manufacturing phase for the mFRR, RR and Black Start services has a major impact on the overall GWP, with shares of 42–64%, 42–64% and 64–78%, respectively. This effect is also related to the low cycles provided by the batteries for satisfying these services. The impact of the manufacturing phase in the overall GWP for CR and ID, Commercial and Residential Arbitrage is modest, varying in the range of 9–12%. The share of the manufacturing and use phase for the other environmental impact categories and for each service is analogous to the GWP one. The manufacturing share is predominant in the case of services with few cycles (mFRR, RR and Black Start). For the others, the increase in the lifetime energy delivered by these batteries lowers the manufacturing impacts. The only exception is represented by the resource depletion. In fact, this category presents a negligible share of the use phase in the overall resource depletion score, with values lower or equal to 27%.

### 3.3. Geopolitical Domain: GRMs Analysis Results

As previously mentioned, the risk mitigating factors are the HHI, NIR, the EOL(RIR) and the SI. The first one is graphically represented in Figure 7 as a bars chart for the extraction stage of the elements under evaluation. Natural Graphite has the higher HHI, equal to 0.46. This is due to China’s high share global of production, equal to 67% (average in the period 2016–2020). Lithium and Aluminium have instead two HHI, respectively, equal to 0.36 and 0.33. The first Lithium producer is Australia, with a share of 56%. For Aluminium, China has a leading role in production, with a share equal to 56%. Furthermore, phosphorous has a HHI at the mining stage (in which the phosphorous is in the form of phosphate rock) equal to 0.22. As in the case of aluminium and natural graphite, China is the largest producer, with a share of total production equal to 44%.

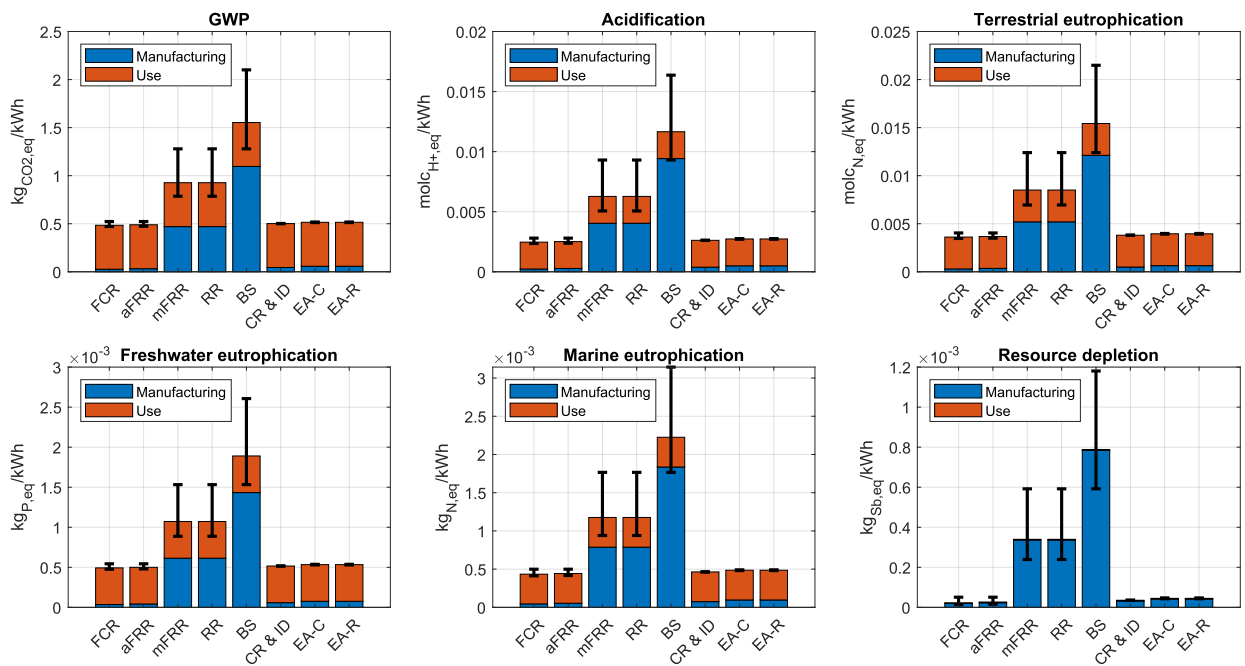


Figure 6. Breakdown of environmental impacts for Scenario C.

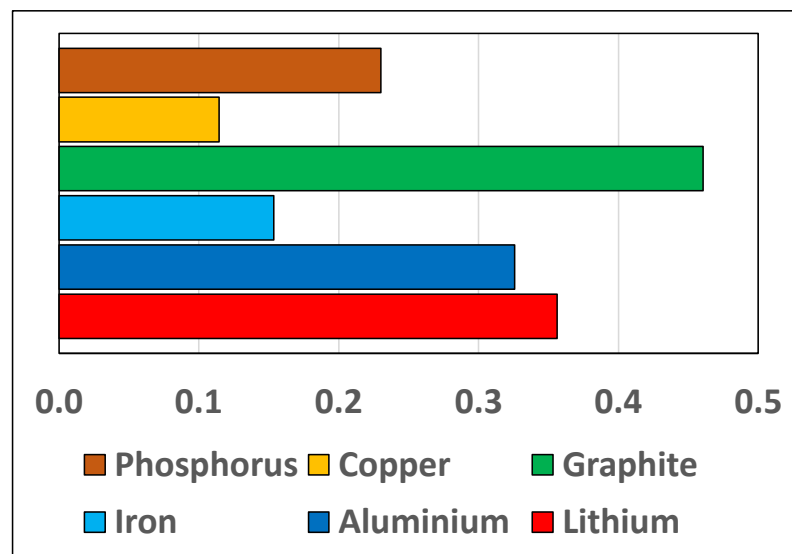


Figure 7. Bar chart of HHI for the elements under evaluation.

Table 9 reports the other risk mitigating factors. The NIR is 100% for refined Phosphorous and Lithium and almost total for Graphite (98%). It is instead slightly lower for Iron (72%). Aluminium and Copper have instead lower NIR values, respectively, equal to 59% and 44%. The value of the end-of-life recycling rate is quite high for Iron 31.5%, and lower for Aluminium (12.3%) and Copper (16.9%). For Graphite and Lithium, these values are almost negligible. Finally, the highest values of the Substitution Index are related to Graphite and Phosphorous, with values equal to 100%.

**Table 9.** Geopolitical risk-mitigating factors.

| Element    | NIR (%) | EOL <sub>RIR</sub> (%) | SI (%) |
|------------|---------|------------------------|--------|
| Aluminium  | 59      | 12.3                   | 80     |
| Copper     | 44      | 16.9                   | 90     |
| Graphite   | 98      | 3                      | 100    |
| Iron       | 72      | 31.5                   | 90     |
| Lithium    | 100     | ≈0                     | 90     |
| Phosphorus | 100     | 0                      | 100    |

The supply risk CFs and the specific quantities of deployed elements are reported in Table 10, as well as the specific risks and their contribution to the final score. The supply risk is scaled to the kWh of the battery energy capacity. Natural Graphite and Phosphorus report the highest absolute score, with values equal to 0.23 and 0.18 kg/kWh, respectively. In fact, their relative contribution to the overall risk is equal to 78%. The other elements instead have a lower contribution to the total risk, since both quantities and supply risk are lower than Graphite and Phosphorus. Particularly, Aluminium, Copper, Iron and Lithium represent 8%, 4%, 7% and 3% of the overall risk quota, respectively. The small value of Lithium (0.02 kg/kWh) compared to the others is determined by the smallest quantity of the selected elements (0.12 kg/kWh), although it represents the third higher value in terms of supply risk (0.16), after Phosphorus (0.35) and Natural Graphite (0.23).

**Table 10.** Breakdown of specific quantities and supply risks.

| Element    | Supply Risk CF (-) | Quantity (kg/kWh <sub>en, cap</sub> ) | Risk (kg/kWh <sub>en, cap</sub> ) | Risk Contribution (%) |
|------------|--------------------|---------------------------------------|-----------------------------------|-----------------------|
| Aluminium  | 0.06               | 0.82                                  | 0.05                              | 8                     |
| Copper     | 0.03               | 0.91                                  | 0.03                              | 4                     |
| Graphite   | 0.23               | 1.36                                  | 0.23                              | 50                    |
| Iron       | 0.05               | 0.91                                  | 0.05                              | 7                     |
| Lithium    | 0.16               | 0.12                                  | 0.02                              | 3                     |
| Phosphorus | 0.35               | 0.51                                  | 0.18                              | 28                    |
| Total      | -                  | 4.63                                  | 0.63                              | 100                   |

Furthermore, quantitative risks, expressed in kg/kWh of electricity delivered throughout the system's useful life, are reported in Table 11 for each scenario and service. As for economic and environmental assessment, the type of service has a fundamental role in determining the supply risk score. Indeed, services characterised by a higher number of cycles (i.e., FCR and aFRR) have the lowest supply risk scores. For Scenario E, supply risk scores of FCR and aFRR are, respectively, equal to  $7.69 \times 10^{-5}$  and  $9.23 \times 10^{-5}$  kg/kWh. Higher values are reported by services featured by a low number of cycles, such as mFRR, RR and Black Start. In detail, supply risk scores of mFRR and RR range between  $1.85 \times 10^{-3}$  and  $4.61 \times 10^{-3}$  kg/kWh, while Black Start values range between  $4.61 \times 10^{-3}$  and  $9.23 \times 10^{-3}$  kg/kWh. Finally, intermediate values are assumed by Arbitrage and CR and ID services, with values within  $2.43 \times 10^{-4}$ – $3.42 \times 10^{-4}$  kg/kWh.

**Table 11.** Overall supply risk of LFP battery for each service and for each scenario, expressed in kg/kWh<sub>en, del</sub>.

| Service               | Scenario A            | Scenario B            | Scenario C            | Scenario D            | Scenario E            |
|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|
| FCR                   | $3.69 \times 10^{-4}$ | $1.45 \times 10^{-4}$ | $1.51 \times 10^{-4}$ | $1.02 \times 10^{-4}$ | $7.69 \times 10^{-5}$ |
| aFRR                  | $3.69 \times 10^{-4}$ | $1.72 \times 10^{-4}$ | $1.80 \times 10^{-4}$ | $1.22 \times 10^{-4}$ | $9.23 \times 10^{-5}$ |
| mFRR                  | $4.61 \times 10^{-3}$ | $3.36 \times 10^{-3}$ | $2.64 \times 10^{-3}$ | $2.17 \times 10^{-3}$ | $1.85 \times 10^{-3}$ |
| RR                    | $4.61 \times 10^{-3}$ | $3.36 \times 10^{-3}$ | $2.64 \times 10^{-3}$ | $2.17 \times 10^{-3}$ | $1.85 \times 10^{-3}$ |
| Black Start           | $9.23 \times 10^{-3}$ | $7.38 \times 10^{-3}$ | $6.15 \times 10^{-3}$ | $5.27 \times 10^{-3}$ | $4.61 \times 10^{-3}$ |
| CR & ID               | $2.56 \times 10^{-4}$ | $2.53 \times 10^{-4}$ | $2.53 \times 10^{-4}$ | $2.46 \times 10^{-4}$ | $2.43 \times 10^{-4}$ |
| Arbitrage-Commercial  | $3.42 \times 10^{-4}$ | $3.33 \times 10^{-4}$ | $3.24 \times 10^{-4}$ | $3.16 \times 10^{-4}$ | $3.08 \times 10^{-4}$ |
| Arbitrage-Residential | $3.42 \times 10^{-4}$ | $3.33 \times 10^{-4}$ | $3.24 \times 10^{-4}$ | $3.16 \times 10^{-4}$ | $3.08 \times 10^{-4}$ |

### 3.4. Sensitivity Analysis

As previously mentioned, a sensitivity analysis is carried out for accounting the effect of final results linked to the reduced cycle life and round-trip efficiency of batteries in the case of low discharge duration. Indeed, low values increase the stress on electrodes due to a fast volume change [53]. Moreover, the discharge efficiency is also reduced. To account for these phenomena, different values were exploited compared to the average ones reported in Table 4. In detail, the cycle life is equal to 2500 cycles and the discharge efficiency is equal to 92% for frequency-based services (i.e., FCR, aFRR and mFRR). A range of cycle life and discharge efficiencies are accounted instead of RR, due to the variability of discharge duration from 0.25 h to 1 h. An overview of the assumptions made for the RR service is reported in Table 12.

**Table 12.** Cycle life expectancy and discharge efficiency considered for the sensitivity analysis of the RR service.

| Parameter           | Scenario A | Scenario B | Scenario C | Scenario D | Scenario E |
|---------------------|------------|------------|------------|------------|------------|
| $\kappa_c$          | 2500       | 3125       | 3750       | 4375       | 5000       |
| $\eta_{DC}^{(dch)}$ | 92%        | 93.5%      | 95%        | 96.5%      | 98%        |

The obtained economic results, according to the assumptions listed in Table 12, are reported in Table 13. In detail, the FCR and aFRR range between  $1.04 \times 10^2$  €/MWh and  $1.37 \times 10^3$  €/MWh. Regarding instead the mFRR, the LCOS ranges between  $6.19 \times 10^3$  €/MWh and  $1.54 \times 10^4$  €/MWh. Finally, the LCOS for RR ranges between  $2.27 \times 10^3$  €/MWh and  $1.54 \times 10^4$  €/MWh. Results for the other services remain unchanged since they are not affected by the parametric analysis. It can be seen how, despite the slightly higher values for LCOS in frequency-based services, relative results and considerations about different electricity services are still the same.

**Table 13.** Results of LCOS (in EUR/MWh) in the sensitivity analysis.

| Service               | Scenario A | Scenario B | Scenario C | Scenario D | Scenario E |
|-----------------------|------------|------------|------------|------------|------------|
| FCR                   | 1373.4     | 233.9      | 149.4      | 119.7      | 104.5      |
| aFRR                  | 1373.4     | 266.6      | 167.3      | 132        | 113.9      |
| mFRR                  | 15,405.1   | 11,219.4   | 8827.6     | 7280       | 6196.6     |
| RR                    | 15,405.1   | 7180.7     | 4371.3     | 3032.6     | 2273.8     |
| Black start           | 11,152.1   | 8932.5     | 7452.8     | 6395.9     | 5603.2     |
| CR and ID             | 280.5      | 242.7      | 226.5      | 216.9      | 210.3      |
| Arbitrage-Commercial  | 766.1      | 560.9      | 514.6      | 489.4      | 471.3      |
| Arbitrage-Residential | 1307.8     | 889.8      | 799.9      | 753.0      | 720.6      |

The environmental impacts of FCR, aFRR, mFRR and RR slightly increase as well, compared to the base case. A graphical overview of the modification in the results due to the sensitivity analysis is reported in Figure 8. In detail, there is an increase in the GWP value of services FCR and aFRR for Scenario A of around 15%. The increase in GWP values for the mFRR and RR are instead lower, and equal to 3.9%. Similar trends are shown for the other impact categories affected by the reduction in cycle life and discharge efficiency.

Finally, in Table 14 the supply risk scores for the parametric analysis are reported. The FCR and aFRR supply risk scores range between  $8.19 \times 10^{-5}$  and  $7.87 \times 10^{-4}$  kg/kWh. The mFRR and RR values range instead between  $1.85 \times 10^{-3}$  kg/kWh and  $4.92 \times 10^{-3}$ .

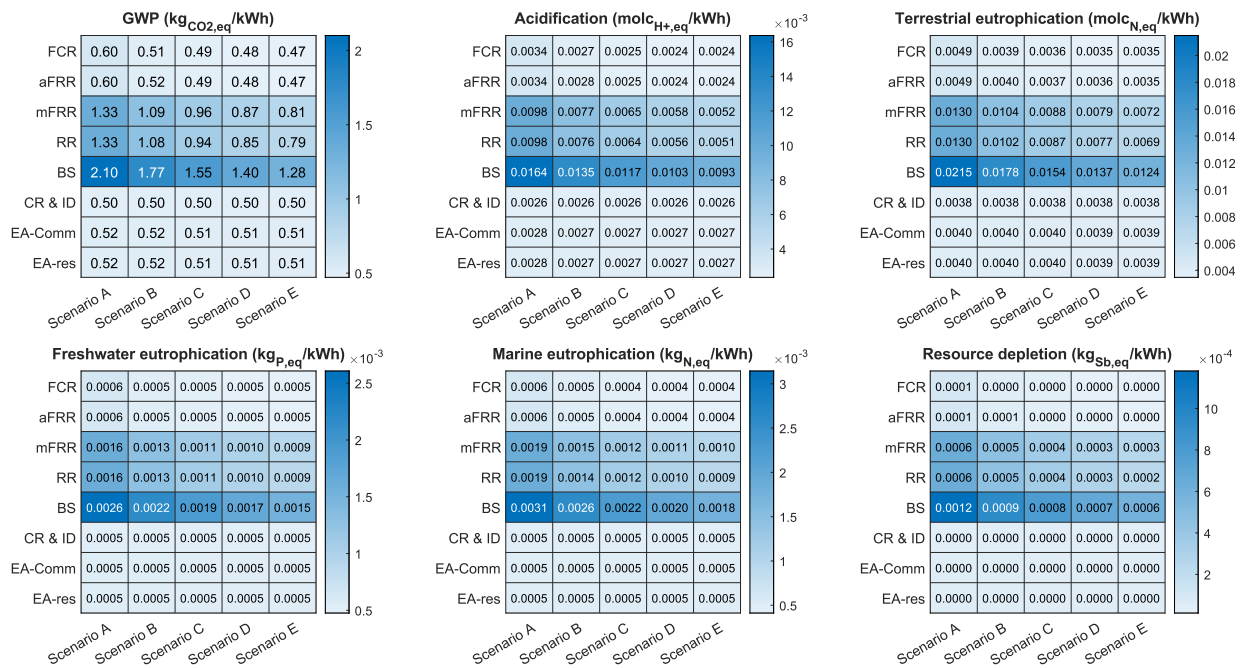


Figure 8. Environmental impacts results in the sensitivity analysis.

Table 14. Supply risk of LFP battery in the sensitivity case, expressed in kg/kWh<sub>en,del</sub>.

| Service               | Scenario A            | Scenario B            | Scenario C            | Scenario D            | Scenario E            |
|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|
| FCR                   | $7.87 \times 10^{-4}$ | $3.08 \times 10^{-4}$ | $1.61 \times 10^{-4}$ | $1.08 \times 10^{-4}$ | $8.19 \times 10^{-5}$ |
| aFRR                  | $7.87 \times 10^{-4}$ | $3.66 \times 10^{-4}$ | $1.92 \times 10^{-4}$ | $1.30 \times 10^{-4}$ | $9.83 \times 10^{-5}$ |
| mFRR                  | $4.92 \times 10^{-3}$ | $3.58 \times 10^{-3}$ | $2.81 \times 10^{-3}$ | $2.31 \times 10^{-3}$ | $1.97 \times 10^{-3}$ |
| RR                    | $4.92 \times 10^{-3}$ | $3.52 \times 10^{-3}$ | $2.72 \times 10^{-3}$ | $2.21 \times 10^{-3}$ | $1.85 \times 10^{-3}$ |
| Black Start           | $9.23 \times 10^{-3}$ | $7.38 \times 10^{-3}$ | $6.15 \times 10^{-3}$ | $5.27 \times 10^{-3}$ | $4.61 \times 10^{-3}$ |
| CR & ID               | $2.56 \times 10^{-4}$ | $2.53 \times 10^{-4}$ | $2.53 \times 10^{-4}$ | $2.46 \times 10^{-4}$ | $2.43 \times 10^{-4}$ |
| Arbitrage-Commercial  | $3.42 \times 10^{-4}$ | $3.33 \times 10^{-4}$ | $3.24 \times 10^{-4}$ | $3.16 \times 10^{-4}$ | $3.08 \times 10^{-4}$ |
| Arbitrage-Residential | $3.42 \times 10^{-4}$ | $3.33 \times 10^{-4}$ | $3.24 \times 10^{-4}$ | $3.16 \times 10^{-4}$ | $3.08 \times 10^{-4}$ |

### 3.5. Discussion

The analysis of the results for the economic, environmental and geopolitical domains shows that the impacts of the battery plants decrease with the increase in the charge/discharge cycles provided throughout the operating lifetime. This is true also in the case of the provision of services that require battery stack replacement during the operation of the battery plants (i.e., FCR and aFRR). The outcomes of the analysis are presented in Table 15 in terms of the best service to provide for Li-ion batteries in order to minimise the impacts for each domain. In detail, for Scenario A, the best service is represented by CR and ID for all the domains considered. Scenario B differs from Scenario A for the best service to provide in order to minimise the economic impact, namely FCR. For all the other scenarios (i.e., Scenario C, Scenario D and Scenario E), the best service is FCR for all three domains.

Table 15. Best services to provide for Li-ion batteries for each domain and scenario considered.

| Domain        | Scenario A | Scenario B | Scenario C | Scenario D | Scenario E |
|---------------|------------|------------|------------|------------|------------|
| Economic      | CR & ID    | FCR        | FCR        | FCR        | FCR        |
| Environmental | CR & ID    | CR & ID    | FCR        | FCR        | FCR        |
| Geopolitical  | CR & ID    | CR & ID    | FCR        | FCR        | FCR        |

#### 4. Conclusions

This paper presented a multidisciplinary approach for the characterization of Li-ion batteries according to three analysis domains, namely economic, environmental and geopolitical ones. While the first two domains are represented by Life Cycle Costing and environmental LCA, the latter one is described through an indicator that measures the risk of supply with reference to the materials used in the battery manufacturing. The multidisciplinary approach has been applied to a Lithium Iron Phosphate battery case study, and a parametric analysis has been carried out according to the main features of the electricity services. The analysis showed that, with reference to the considered scenarios, the “Frequency Containment Reserve” and the “Congestion Relief and Investment Deferral” results are the services better fitting with the indicators developed to cover the three analysis domains, even though the “Frequency Containment Reserve” results overcome the “Congestion Relief and Investment Deferral” in a higher number of scenarios. The developed approach can hence help decision makers in choosing among different energy storage technologies (ESTs) during the planning stages by considering all the electric services that these technologies can provide. Usually, EST assessment is performed by considering economic aspects, environmental impact and supply chain risk in an isolated way, neglecting the complexity of the interactions of the different domains and the trade-offs among the criteria. However, decision makers need a coherent and exhaustive framework for the evaluation of ESTs. This approach can be extended to other ESTs, obtaining in this way a fair comparison between them. This is due to the fact that this methodology takes into account not only economic, environmental and supply risk features, but also the technical aspects through the functional unit at which results are normalised. Further evaluation will be carried out in order to analyse further domains (e.g., social life cycle assessment), as well as to compare different ESTs according to the proposed impact categories. Moreover, geopolitical risk analysis will be extended to other manufacturing stages to provide an overall vision of the supply chain and the potential threats to be overcome to enable the use of these technologies.

**Author Contributions:** Conceptualization, S.C. (Salvatore Cellura) and A.M.; methodology, S.C. (Salvatore Cellura) and A.M.; software, S.C. (Salvatore Cellura); formal analysis, S.C. (Salvatore Cellura) and A.M.; investigation, S.C. (Salvatore Cellura); resources, S.C. (Stefano Corgnati); data curation, S.C. (Salvatore Cellura); writing—original draft preparation, S.C. (Salvatore Cellura); writing—review and editing, A.M.; visualization, E.B. and S.C. (Stefano Corgnati); supervision, E.B. and S.C. (Stefano Corgnati). All authors have read and agreed to the published version of the manuscript.

**Funding:** This research received no external funding.

**Data Availability Statement:** The data presented in this study are available upon request from the corresponding author.

**Conflicts of Interest:** The authors declare no conflict of interest.

#### Abbreviations

The following abbreviations are used in this manuscript:

|         |   |
|---------|---|
| ACD     | Acidification                             |
| aFRR    | automatic Frequency Restoration Reserve   |
| BMS     | Battery Management System                 |
| BS      | Black Start                               |
| CD & ID | Congestion Relief and Investment Deferral |
| EA      | Energy Arbitrage                          |
| eLCA    | environmental Life Cycle Assessment       |
| EoL-RIR | End of Life Recycling Input Rate          |
| EST     | Energy Storage Technology                 |

|            |   |
|------------|---|
| FCR        | Frequency Containment Reserve                   |
| FE         | Freshwater Eutrophication                       |
| GWP        | Global Warming Potential                        |
| HHI        | Herfindahl–Hirschman Index                      |
| LCOS       | Levelised Cost of Storage                       |
| LFP Li-ion | lithium iron phosphate lithium-ion battery type |
| ME         | Marine Eutrophication                           |
| mFRR       | manual Frequency Restoration Reserve            |
| O&M        | Operation and Maintenance                       |
| RR         | Replacement Reserve                             |
| NIR        | Net Import Reliance                             |
| TE         | Terrestrial Eutrophication                      |
| TLCC       | Total Life Cycle Cost                           |
| WACC       | Weighted Average Cost of Capital                |

## References

- UNFCCC. The Paris Agreement. 2015. Available online: <https://unfccc.int/process-and-meetings/the-paris-agreement/the-paris-agreement> (accessed on 29 January 2023).
- European Commission. EU-27 2030 Climate & Energy Framework. Available online: [https://climate.ec.europa.eu/eu-action/climate-strategies-targets/2030-climate-energy-framework\\_en](https://climate.ec.europa.eu/eu-action/climate-strategies-targets/2030-climate-energy-framework_en) (accessed on 29 January 2023).
- European Environment Agency (EEA). *Greenhouse Gas Emissions (GHG) by Sector: EU-27*; Technical Report; European Environment Agency (EEA): Copenhagen, Denmark, 2022.
- United Nations Economic Commission for Europe (UNECE). *Life Cycle Assessment of Electricity Generation Options*; Technical Report; United Nations Economic Commission for Europe (UNECE): Geneva, Switzerland, 2021.
- Eurostat. *SHARES (Renewables)*; Eurostat: Luxembourg, 2021.
- Guerra, K.; Haro, P.; Gutiérrez, R.; Gómez-Barea, A. Facing the high share of variable renewable energy in the power system: Flexibility and stability requirements. *Appl. Energy* **2022**, *310*, 118561. [[CrossRef](#)]
- Babatunde, O.; Munda, J.; Hamam, Y. Power system flexibility: A review. *Energy Rep.* **2020**, *6*, 101–106. [[CrossRef](#)]
- Kebede, A.A.; Kalogiannis, T.; Van Mierlo, J.; Berecibar, M. A comprehensive review of stationary energy storage devices for large scale renewable energy sources grid integration. *Renew. Sustain. Energy Rev.* **2022**, *159*, 112213. [[CrossRef](#)]
- European Commission; Tarvydas, D.; Tsiropoulos, I.; Lebedeva, N. *Li-Ion Batteries for Mobility and Stationary Storage Applications: Scenarios for Costs and Market Growth*; Publications Office of the European Union: Luxembourg, 2018. [[CrossRef](#)]
- European Battery Alliance. Available online: [https://single-market-economy.ec.europa.eu/industry/strategy/industrial-alliances/european-battery-alliance\\_en](https://single-market-economy.ec.europa.eu/industry/strategy/industrial-alliances/european-battery-alliance_en) (accessed on 29 January 2023).
- European Commission. *State of the Energy Union 2022*; Technical Report; European Commission: Brussels, Belgium, 2022.
- European Commission. *Progress on Competitiveness of Clean Energy Technologies*; Technical Report; European Commission: Brussels, Belgium, 2022.
- Huisman, J.; Ciuta, T.; Mathieux, F.; Bobba, S.; Georgitzikis, K.; Pennington, D. *RMIS—Raw Materials in the Battery Value Chain*; Technical Report; Publications Office of the European Union: Luxembourg, 2020. [[CrossRef](#)]
- Characterization of raw materials based on supply risk indicators for Europe. *Int. J. Life Cycle Assess* **2018**, *23*, 726–738. [[CrossRef](#)]
- British Geological Survey. *An Update to the Supply Risk Index for Elements and Element Groups That Are of Economic Value*; Technical Report; British Geological Survey: Nottingham, UK, 2015.
- European Commission. *Annexes to the Report on Critical Raw Materials for the EU: Report of the Ad Hoc Working Group on Defining Critical Raw Materials*; Technical Report; European Commission: Brussels, Belgium, 2010.
- European Commission. *Annexes to the Report on Critical Raw Materials for the EU: Report of the Ad Hoc Working Group on Defining Critical Raw Materials*; Technical Report; European Commission: Brussels, Belgium, 2014.
- Blengini, G.A.; Blagoeva, D.; Dewulf, J.; Torres de Matos, C.; Nita, V.; Vidal-Legaz, B.; Latunussa, C.; Kayam, Y.; Talens Peirò, L.; Baranzelli, C.; et al. *Assessment of the Methodology for Establishing the EU List of Critical Raw Materials: Background Report*; JRC Technical Reports; Publications Office of the European Union: Luxembourg, 2017. [[CrossRef](#)]
- European Commission. *Critical Raw Materials Resilience: Charting a Path towards Greater Security and Sustainability*; Technical Report; European Commission: Brussels, Belgium, 2020.
- National Research Council. *Minerals, Critical Minerals, and the U.S. Economy*; The National Academies Press: Washington, DC, USA, 2008. [[CrossRef](#)]
- Graedel, T.E.; Harper, E.M.; Nassar, N.T.; Nuss, P.; Reck, B.K. Criticality of metals and metalloids. *Proc. Natl. Acad. Sci. USA* **2015**, *112*, 4257–4262. [[CrossRef](#)]
- Helbig, C.; Bradshaw, A.M.; Kolotzek, C.; Thorenz, A.; Tuma, A. Supply risks associated with CdTe and CIGS thin-film photovoltaics. *Appl. Energy* **2016**, *178*, 422–433. [[CrossRef](#)]
- Helbig, C.; Bradshaw, A.M.; Wietschel, L.; Thorenz, A.; Tuma, A. Supply risks associated with lithium-ion battery materials. *J. Clean. Prod.* **2018**, *172*, 274–286. [[CrossRef](#)]

24. Cimprich, A.; Karim, K.S.; Young, S.B. Extending the geopolitical supply risk method: Material “substitutability” indicators applied to electric vehicles and dental X-ray equipment. *Int. J. Life Cycle Assess.* **2018**, *23*, 2024–2042. [CrossRef]
25. Gemechu, E.D.; Sonnemann, G.; Young, S.B. Geopolitical-related supply risk assessment as a complement to environmental impact assessment: The case of electric vehicles. *Int. J. Life Cycle Assess.* **2017**, *22*, 31–39. [CrossRef]
26. Gemechu, E.D.; Helbig, C.; Sonnemann, G.; Thorenz, A.; Tuma, A. Import-based Indicator for the Geopolitical Supply Risk of Raw Materials in Life Cycle Sustainability Assessments. *J. Ind. Ecol.* **2016**, *20*, 154–165.
27. Santillán-Saldivar, J.; Cimprich, A.; Shaikh, N.; Laratte, B.; Young, S.B.; Sonnemann, G. How recycling mitigates supply risks of critical raw materials: Extension of the geopolitical supply risk methodology applied to information and communication technologies in the European Union. *Resour. Conserv. Recycl.* **2021**, *164*, 105108. [CrossRef]
28. Helbig, C.; Gemechu, E.D.; Pillain, B.; Young, S.B.; Thorenz, A.; Tuma, A.; Sonnemann, G. Extending the geopolitical supply risk indicator: Application of life cycle sustainability assessment to the petrochemical supply chain of polyacrylonitrile-based carbon fibers. *J. Clean. Prod.* **2016**, *137*, 1170–1178. [CrossRef]
29. European Commission; Joint Research Centre; Institute for Environment and Sustainability. *International Reference Life Cycle Data System (ILCD) Handbook: Framework and Requirements for Life Cycle Impact Assessment Models and Indicators*; Technical Report; Publications Office of the European Union: Luxembourg, 2010. [CrossRef]
30. Raw material criticality in the context of classical risk assessment. *Resour. Policy* **2015**, *44*, 35–46. [CrossRef]
31. Chowdhury, J.I.; Balta-Ozkan, N.; Goglio, P.; Hu, Y.; Varga, L.; McCabe, L. Techno-environmental analysis of battery storage for grid level energy services. *Renew. Sustain. Energy Rev.* **2020**, *131*, 110018. [CrossRef]
32. Stenzel, P.; Koj, J.C.; Schreiber, A.; Hennings, W.; Zapp, P. Primary control provided by large-scale battery energy storage systems or fossil power plants in Germany and related environmental impacts. *J. Energy Storage* **2016**, *8*, 300–310. [CrossRef]
33. Koj, J.C.; Stenzel, P.; Schreiber, A.; Hennings, W.; Zapp, P.; Wrede, G.; Hahndorf, I. Life Cycle Assessment of Primary Control Provision by Battery Storage Systems and Fossil Power Plants. *Energy Procedia* **2015**, *73*, 69–78.
34. Le Varlet, T.; Schmidt, O.; Gambhir, A.; Few, S.; Staffell, I. Comparative life cycle assessment of lithium-ion battery chemistries for residential storage. *J. Energy Storage* **2020**, *28*, 101230. [CrossRef]
35. Lamperti Tornaghi, M.; Loli, A.; Negro, P. Balanced Evaluation of Structural and Environmental Performances in Building Design. *Buildings* **2018**, *8*, 52. [CrossRef]
36. Diaz-Londono, C.; Enescu, D.; Ruiz, F.; Mazza, A. Experimental modeling and aggregation strategy for thermoelectric refrigeration units as flexible loads. *Appl. Energy* **2020**, *272*, 115065. [CrossRef]
37. Argyrou, M.C.; Christodoulides, P.; Kalogirou, S.A. Energy storage for electricity generation and related processes: Technologies appraisal and grid scale applications. *Renew. Sustain. Energy Rev.* **2018**, *94*, 804–821. [CrossRef]
38. International Electrotechnical Commission (IEC). IEC 60050, Definition of Prosumer. 2017. Available online: <https://electropedia.org/iev/iev.nsf/display?openform&ievref=617-02-16> (accessed on 12 May 2023).
39. Palizban, O.; Kauhaniemi, K. Energy storage systems in modern grids—Matrix of technologies and applications. *J. Energy Storage* **2016**, *6*, 248–259. [CrossRef]
40. Asian Development Bank. *Handbook on Battery Energy Storage System*; Technical Report; Asian Development Bank: Mandaluyong, Philippines, 2018. [CrossRef]
41. International Renewable Energy Agency (IRENA). *Electricity Storage and Renewables: Costs and Markets to 2030*; Technical Report; International Renewable Energy Agency (IRENA): Masdar City, United Arab Emirates, 2017.
42. Laca, A.; Herrero, M.; Díaz, M. 2.60—Life Cycle Assessment in Biotechnology. In *Comprehensive Biotechnology*, 2nd ed.; Moo-Young, M., Ed.; Academic Press: Burlington, MA, USA, 2011; pp. 839–851. [CrossRef]
43. Sala, S.; Wolf, M.A.; Pant, R. *Characterisation Factors of the ILCD Recommended Life Cycle Impact Assessment Methods. Database and Supporting Information*; European Commission: Brussels, Belgium, 2012. [CrossRef]
44. Song, J.; Yan, W.; Cao, H.; Song, Q.; Ding, H.; Lv, Z.; Zhang, Y.; Sun, Z. Material flow analysis on critical raw materials of lithium-ion batteries in China. *J. Clean. Prod.* **2019**, *215*, 570–581. [CrossRef]
45. Kaufmann, D.; Kraay, A.; Mastruzzi, M. *The Worldwide Governance Indicators: Methodology and Analytical Issues*; Policy Research Working Paper Series 5430; The World Bank: Washington, DC, USA, 2010.
46. Majeau-Bettez, G.; Hawkins, T.R.; Strømman, A.H. Life Cycle Environmental Assessment of Lithium-Ion and Nickel Metal Hydride Batteries for Plug-In Hybrid and Battery Electric Vehicles. *Environ. Sci. Technol.* **2011**, *45*, 4548–4554.
47. Carvalho, M.L.; Temporelli, A.; Girardi, P. Life Cycle Assessment of Stationary Storage Systems within the Italian Electric Network. *Energies* **2021**, *14*, 2047. [CrossRef]
48. Peters, J.F.; Baumann, M.; Zimmermann, B.; Braun, J.; Weil, M. The environmental impact of Li-Ion batteries and the role of key parameters—A review. *Renew. Sustain. Energy Rev.* **2017**, *67*, 491–506. [CrossRef]
49. Ameli, M.T.; Ameli, A. Chapter 12—Electric vehicles as means of energy storage: Participation in ancillary services markets. In *Energy Storage in Energy Markets*; Mohammadi-Ivatloo, B., Mohammadpour Shotorbani, A., Anvari-Moghaddam, A., Eds.; Academic Press: Cambridge, MA, USA, 2021; pp. 235–249. [CrossRef]
50. Waag, W.; Sauer, D. SECONDARY BATTERIES—LEAD—ACID SYSTEMS | State-of-Charge/Health. In *Encyclopedia of Electrochemical Power Sources*; Garche, J., Ed.; Elsevier: Amsterdam, The Netherlands, 2009; pp. 793–804. [CrossRef]
51. Spiers, D. Chapter IIB-2—Batteries in PV Systems. In *Practical Handbook of Photovoltaics*, 2nd ed.; McEvoy, A., Markvart, T., Castañer, L., Eds.; Academic Press: Boston, MA, USA, 2012; pp. 721–776. [CrossRef]

52. Life cycle assessment (LCA) of a battery home storage system based on primary data. *J. Clean. Prod.* **2022**, *366*, 132899. [CrossRef]
53. Preger, Y.; Barkholtz, H.M.; Fresquez, A.; Campbell, D.L.; Juba, B.W.; Romàn-Kustas, J.; Ferreira, S.R.; Chalamala, B. Degradation of Commercial Lithium-Ion Cells as a Function of Chemistry and Cycling Conditions. *J. Electrochem. Soc.* **2020**, *167*, 120532. [CrossRef]
54. Akhil, A.A.; Huff, G.; Currier, A.B.; Hernandez, J.; Bender, D.A.; Kaun, B.C.; Rastler, D.M.; Chen, S.B.; Cotter, A.L.; Bradshaw, D.T.; et al. *DOE/EPRI Electricity Storage Handbook in Collaboration with NRECA*; U.S. Department of Energy: Washington, DC, USA, 2016. [CrossRef]
55. Luo, X.; Wang, J.; Dooner, M.; Clarke, J. Overview of current development in electrical energy storage technologies and the application potential in power system operation. *Appl. Energy* **2015**, *137*, 511–536. [CrossRef]
56. Augustine, C.; Blair, N. *Energy Storage Futures Study: Storage Technology Modeling Input Data Report*; NREL/TP-5700-78694; National Renewable Energy Laboratory: Golden, CO, USA, 2021.
57. Mongird, K.; Viswanathan, V.; Balducci, P.; Alam, J.; Fotedar, V.; Koritarov, V.; Hadjerioua, B. An Evaluation of Energy Storage Cost and Performance Characteristics. *Energies* **2020**, *13*, 3307. [CrossRef]
58. Quintel. Energy Transition Model. Available online: <https://docs.energytransitionmodel.com/main/cost-wacc/> (accessed on 12 May 2023).
59. *Renewable Power Generation Costs in 2020*; International Renewable Energy Agency: Abu Dhabi, United Arab Emirates, 2021.
60. Reichl, C.; Schatz, M. *World Mining Data 2022*; Austrian Federal Ministry of Finance (BMF): Vienna, Austria, 2022.
61. European Commission and Directorate-General for Internal Market, Industry, Entrepreneurship and SMEs. *Study on the Review of the List of Critical Raw Materials: Final Report*; Publications Office: Luxembourg, 2017. [CrossRef]
62. Graedel, T.; Harper, E.; Nassar, N.; Reck, B. On the materials basis of modern society. *Proc. Natl. Acad. Sci. USA* **2015**, *112*, 6295–6300. [CrossRef]
63. Tercero Espinoza, L.A. Critical appraisal of recycling indicators used in European criticality exercises and circularity monitoring. *Resour. Policy* **2021**, *73*, 102208. [CrossRef]

**Disclaimer/Publisher’s Note:** The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content.